

# 7SR11 and 7SR12

Performance Specification

## Document Release History

This document is issue 2012/02. The list of revisions up to and including this issue is:

2012/02	AC auxiliary power supply added
2012/01	Software Maintenance
2011/06	Software Maintenance
2010/04	Amendments following PLM review
2010/02	Reformat due to rebrand
2009/09	Revised format
2009/04	First issue

## Software Revision History

2012/01	7SR11 2436H80003 R2a-2a 7SR12 2436H80004 R2a-2a	Software Maintenance
2011/06	7SR11 2436H80003 R2-2 7SR12 2436H80004 R2-2	Software Maintenance
2009/04	7SR11 2436H80003 R1g-1c 7SR12 2436H80004 R1g-1c	First Release

The copyright and other intellectual property rights in this document, and in any model or article produced from it (and including any registered or unregistered design rights) are the property of Siemens Protection Devices Limited. No part of this document shall be reproduced or modified or stored in another form, in any data retrieval system, without the permission of Siemens Protection Devices Limited, nor shall any model or article be reproduced from this document unless Siemens Protection Devices Limited consent.

While the information and guidance given in this document is believed to be correct, no liability shall be accepted for any loss or damage caused by any error or omission, whether such error or omission is the result of negligence or any other cause. Any and all such liability is disclaimed.

## Contents

Section 1: Common Functions .....	5
1.1 General .....	5
1.1.1 CE Conformity .....	5
1.1.2 Reference .....	5
1.1.3 Dimensions .....	5
1.1.4 Weights .....	5
1.2 Energising Quantities .....	6
1.2.1 Auxiliary Power Supply .....	6
1.2.2 AC Analogue Current .....	7
1.2.3 AC Analogue Voltage .....	7
1.2.4 Binary (Digital) Outputs .....	8
1.2.5 Binary (Digital) Inputs .....	8
1.3 Functional performance .....	10
1.3.1 Instrumentation .....	10
1.3.2 USB 2.0 Data Communication Interface .....	10
1.3.3 RS485 Data Communication Interface .....	10
1.3.4 Real Time Clock .....	10
1.4 Environmental Performance .....	11
1.4.1 General .....	11
1.4.2 Emissions .....	11
1.4.3 Immunity .....	12
1.4.4 Mechanical .....	13
Section 2: Protection Functions .....	15
2.1 27/59 Under/over voltage .....	15
2.1.1 Reference .....	15
2.1.2 Operate and Reset Level .....	15
2.1.3 Operate and Reset Time .....	15
2.2 37 Undercurrent .....	16
2.2.1 Reference .....	16
2.2.2 Operate and Reset Level .....	16
2.2.3 Operate and Reset Time .....	16
2.3 46NPS Negative Phase Sequence Overcurrent .....	17
2.3.1 Reference (46DT) .....	17
2.3.2 Operate and Reset Level (46DT) .....	17
2.3.3 Operate and Reset Time (46DT) .....	17
2.3.4 Reference (46IT) .....	17
2.3.5 Operate and Reset Level (46IT) .....	17
2.3.6 Operate and Reset Time (46IT) .....	18
2.4 47 Negative Phase Sequence Voltage .....	19
2.4.1 Reference (47) .....	19
2.4.2 Operate and Reset Level (47) .....	19
2.4.3 Operate and Reset Time (47) .....	19
2.5 49 Thermal Overload .....	20
2.5.1 Reference .....	20
2.5.2 Operate and Reset Level .....	20
2.5.3 Operate and Reset Time .....	20
2.6 50 Instantaneous Overcurrent .....	22
2.6.1 Reference .....	22
2.6.2 Operate and Reset Level .....	22
2.6.3 Operate and Reset Time .....	22
2.7 50G Instantaneous Measured Earth Fault .....	23
2.7.1 Reference .....	23
2.7.2 Operate and Reset Level .....	23
2.7.3 Operate and Reset Time .....	23
2.8 50N Instantaneous Derived Earth Fault .....	24
2.8.1 Reference .....	24
2.8.2 Operate and Reset Level .....	24
2.8.3 Operate and Reset Time .....	24

2.9	50SEF Instantaneous Sensitive Earth Fault.....	25
2.9.1	Reference .....	25
2.9.2	Operate and Reset Level .....	25
2.9.3	Operate and Reset Time.....	25
2.10	51 Time Delayed Overcurrent.....	26
2.10.1	Reference .....	26
2.10.2	Operate and Reset Level .....	26
2.10.3	Operate and Reset Time.....	26
2.11	51G Time Delayed Measured Earth Fault.....	32
2.11.1	Reference .....	32
2.11.2	Operate and Reset Level .....	32
2.11.3	Operate and Reset Time.....	32
2.12	51N Time Delayed Derived Earth Fault.....	34
2.12.1	Reference .....	34
2.12.2	Operate and Reset Level .....	34
2.12.3	Operate and Reset Time.....	34
2.13	51SEF Time Delayed Sensitive Earth Fault.....	36
2.13.1	Reference .....	36
2.13.2	Operate and Reset Level .....	36
2.13.3	Operate and Reset Time.....	36
2.14	51V Voltage Controlled Overcurrent .....	38
2.14.1	Reference .....	38
2.14.2	Operate and Reset Level .....	38
2.15	59N Neutral Voltage Displacement .....	39
2.15.1	Reference (59NDT).....	39
2.15.2	Operate and Reset Level (59NDT) .....	39
2.15.3	Operate and Reset Time (59NDT).....	39
2.15.4	Reference (59NIT) .....	39
2.15.5	Operate and Reset Level (59NIT).....	39
2.16	64H Restricted Earth Fault Protection.....	41
2.16.1	Reference .....	41
2.16.2	Operate and Reset Level .....	41
2.16.3	Operate and Reset Time.....	41
2.17	67/67N Directional Overcurrent & Earth Fault.....	42
2.17.1	Reference .....	42
2.17.2	Operate Angle.....	42
2.17.3	Operate Threshold .....	42
2.17.4	Operate and Reset Time.....	42
2.18	Directional SEF - Wattmetric.....	43
2.18.1	Reference .....	43
2.18.2	Operate and Reset Level .....	43
2.18.3	Operate and Reset Time.....	43
2.19	81 Under/over frequency.....	44
2.19.1	Reference .....	44
2.19.2	Operate and Reset Level .....	44
2.19.3	Operate and Reset Time.....	44
Section 3: Supervision Functions.....		45
3.1	46BC Broken Conductor .....	45
3.1.1	Reference .....	45
3.1.2	Operate and Reset Level .....	45
3.1.3	Operate and Reset Time.....	45
3.2	50BF Circuit Breaker Fail.....	46
3.2.1	Reference .....	46
3.2.2	Operate and Reset Level .....	46
3.2.3	Operate and Reset Time.....	46
3.3	60CTS & 60CTS-I Current Transformer Supervision .....	47
3.3.1	Reference .....	47
3.3.2	Current & Voltage Threshold.....	47
3.3.3	Operate and Reset Time.....	47
3.4	60VTS Voltage Transformer Supervision.....	48
3.4.1	Reference .....	48
3.4.2	Operate and Reset Level .....	48
3.4.3	Operate and Reset Time.....	48

3.5	74TCS & 74CCS Trip & Close Circuit Supervision .....	49
3.5.1	Reference .....	49
3.5.2	Operate and Reset Time.....	49
3.6	81HBL2 Inrush Detector.....	49
3.6.1	Reference .....	49
3.6.2	Operate and Reset Time.....	49

## List of Figures

Figure 1.2-1	Binary Input Configurations Providing Compliance with EATS 48-4 Classes ESI 1 and ESI 2 .....	9
Figure 2.5-1	Thermal Overload Protection Curves .....	21
Figure 2.10-1	IEC IDMTL Curves (Time Multiplier=1).....	28
Figure 2.10-2	ANSI IDMTL Operate Curves (Time Multiplier=1) .....	29
Figure 2.10-3	ANSI Reset Curves (Time Multiplier=1).....	30
Figure 2.10-4	IEC Reset Curves (Time Multiplier=1) .....	31

## Section 1: Common Functions

### 1.1 General

#### 1.1.1 CE Conformity

**CE** This product is CE compliant to relevant EU directives.

#### 1.1.2 Reference

This product complies with IEC 60255-3, IEC 60255-6, IEC60255-11, IEC 60255-12 and IEC61000-4-8.

##### 1.1.2.1 Accuracy Reference Conditions

This product has been tested under the following conditions, unless specifically stated otherwise.

Parameter	Value
Auxiliary supply	nominal
Frequency	nominal
Ambient temperature	20 °C

#### 1.1.3 Dimensions

Parameter	Value
Width E4 case	103.5 mm
Height	177 mm
Depth behind panel (including clearance for wiring and fibre)	241.5 mm
Projection (from front of panel)	31 mm

See appropriate case outline and panel drilling drawing, as specified in Diagrams and Parameters of the Installation section, for complete dimensional specifications.

#### 1.1.4 Weights

Parameter	Value	
Net weight	7SR1101, E4 case	2.7 kg
	7SR1102, E4 case	3.2 kg
	7SR1103, E4 case	3.2 kg
	7SR1204, E4 case	2.7 kg
	7SR1205, E4 case	3.2 kg
	7SR1206, E4 case	3.2 kg

## 1.2 Energising Quantities

### 1.2.1 Auxiliary Power Supply

IEC60255-11 &amp; EATS 48-4

Nominal Operating Range		Absolute Range*	Comments
V <sub>aux</sub>	24 to 60 VDC	18 to 72 VDC	Low voltage PSU suitable for 24VDC, 30VDC,48VDC and 60VDC systems
	80 to 250 VDC	64 to 300 VDC	High Voltage PSU suitable for 115VAC, 110VDC and 220VDC systems.
	115 VAC 50/60Hz	92 to 138 V rms AC 47.5-52.5/57-63Hz	High Voltage PSU suitable for 115VAC, 110VDC and 220VDC systems.

\*No relay operation outside of this range is permissible or implied.

#### 1.2.1.1 Burden

Attribute		Value
24V DC	Minimum	3.9 W
	User Access (back light)	5.3 W
	Maximum	8.0W
60V DC	Minimum	3.9W
	User Access (back light)	5.2 W
	Maximum	7.3W
80V DC	Minimum	4.0W
	User Access (back light)	5.5W
	Maximum	6.5W
250V DC	Minimum	4.2W
	User Access (back light)	5.4W
	Maximum	7.5W
115V AC	Minimum	9VA 0.5PF approx.
	User Access (back light)	10VA 0.5PF approx.
	Maximum	15VA 0.5PF approx.

#### 1.2.1.2 Operational Features

Attribute	Value	Comments
0% Dip Withstand Period	50ms	
Dip Immunity Acquisition Period	5minutes	Typical time after switch on to attain claimed immunity to dips
<p>NOTE: Dips in supply that fall below the minimum voltage for a period greater than the 0% Dip With stand Period will invoke a relay reset.</p> <p>During conditions of auxiliary input voltage variations which are not described <sup>(1)</sup> in section 1.4.3.1, the relay may enter a safety protection mode where a power supply shutdown occurs. This condition is designed to protect the power supply from damage as well as prevent internal relay faults from developing into dangerous situations.</p> <p>Once the relay has entered this safety mode, it may be necessary to reduce the auxiliary input voltage to zero volts for up to 30 seconds before re-application of the auxiliary supply will cause the relay to power up and operate normally.</p> <p>(1) Using fuses as on/off switches or allowing batteries to run at very low cell voltages for extended periods and then attempting to re-charge them are examples of such auxiliary supply conditions.</p>		

### 1.2.2 AC Analogue Current

Nominal		Measuring Range
$I_n$	1, 5 A Phase, Earth and SEF	$80 \times I_n$
$f_n$	50, 60Hz	47.5 to 52.5Hz and 57 to 63Hz

Note. 1A and 5A nominal inputs are user selectable on each model.

#### 1.2.2.1 Burden

Attribute	Value - Phase, Earth and SEF	
	1A	5A
AC Burden	$\leq 0.1 \text{ VA}$	$\leq 0.3 \text{ VA}$
Input Impedance (typical)	$0.05 \Omega$	$0.01 \Omega$

#### 1.2.2.2 Thermal Withstand EATS48-5

Overload Period	Overload Current	
	Phase, Earth and SEF	
	1A	5A
Continuous	$3.0 \times I_n$	
10 minutes	$3.5 \times I_n$	
5 minutes	$4.0 \times I_n$	
3 minutes	$5.0 \times I_n$	
2 minutes	$6.0 \times I_n$	
3 seconds	57.7A	202A
2 seconds	70.7A	247A
1 second	100A	350A
1 cycle	700A	2500A

### 1.2.3 AC Analogue Voltage

Nominal		Operating Range
$V_n$	63.5V, 110 V	270 V
$f_n$	50, 60Hz	47.5 to 52.5Hz and 57 to 63Hz

#### 1.2.3.1 Burden

Attribute	Value
AC Burden	- 0.02 VA @ 63.5 V , $\leq 0.06 \text{ VA @ 110 V}$

## 1.2.4 Binary (Digital) Outputs

Contact rating to IEC 60255-0-2

Attribute		Value
Carry continuously		5A AC or DC
Make and carry (L/R ≤ 40 ms and V ≤ 300 V)	for 0.5 s	20A AC or DC
	for 0.2 s	30A AC or DC
Break (≤ 5 A and ≤ 300 V)	AC resistive	1250 VA
	AC inductive	250 VA at p.f. ≤ 0.4
	DC resistive	75 W
	DC inductive	30 W at L/R ≤ 40ms 50 W at L/R ≤ 10ms
Contact Operate / Release Time		7ms / 3ms
Minimum number of operations		1000 at maximum load
Minimum recommended load		0.5 W at minimum of 10mA or 5V

## 1.2.5 Binary (Digital) Inputs

DC operation EATS48-4

Nominal		Operating Range
$V_{BI}$	19 VDC	17 to 320 VDC
	88 VDC	74 to 320 VDC

AC operation

Nominal		Operating Range
$V_{BI}$	19 VDC	92 to 138 $V_{RMSAC}$

### 1.2.5.1 DC Performance

Attribute		Value
Maximum DC current for operation	$V_{BI} = 19 V$	1.5mA
	$V_{BI} = 88 V$	1.5mA
Reset/Operate voltage ratio		≥ 90 %
Response time		< 9ms
Response time when programmed to energise an output relay contact (i.e. includes output relay operation)		< 20ms

The binary inputs have a low minimum operate current and may be set for high speed operation. Where a binary input is both used to influence a control function (e.g. provide a tripping function) and it is considered to be susceptible to mal-operation due to capacitive currents, the external circuitry can be modified to provide immunity to such disturbances.

To comply with EATS 48-4, classes ESI 1 and ESI 2, external components / BI pick-up delays are required as shown in fig. 1-1.

To achieve immunity from AC interference, a BI pick-up delay of typically one-cycle can be applied.



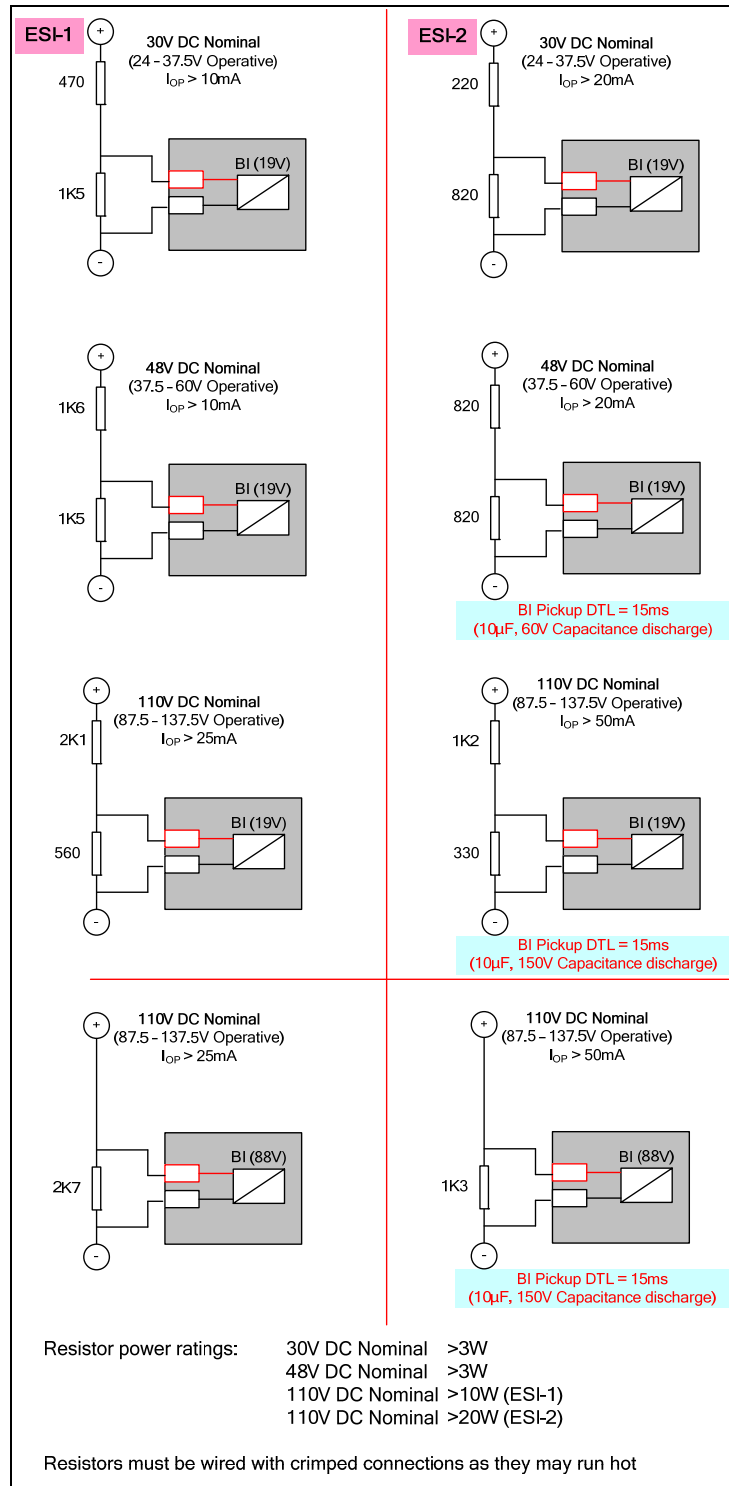


Figure 1.2-1 Binary Input Configurations Providing Compliance with EATS 48-4 Classes ESI 1 and ESI 2

## 1.2.5.2 AC Performance

Attribute		Value
Maximum peak current for operation	$V_{BI} = 19 \text{ V}$	1.5mA
Response time @115V <sub>RMS</sub> AC		< 16ms
Response time when programmed to energise an output relay contact (i.e. includes output relay operation)		< 26ms

For AC operation the BI pick-up delay should be set to 0ms and the drop-off delay to 25ms.

For AC operation wiring should be screened twisted pair for any wiring run which is greater than 10 metres in length.

## 1.3 Functional performance

### 1.3.1 Instrumentation

	Instrument Value	Reference	Typical accuracy
I	Current	$I \geq 0.1 \times I_n$	$\pm 1 \% I_n$ or $\pm 5 \text{ mA}$
V	Voltage	$V \geq 0.8 \times V_n$	$\pm 1 \% V_n$
W, Var, VA	Power, real and apparent	$V = V_n, I \geq 0.1 \times I_n, \text{ pf} \geq 0.8$	$\pm 3\% P_n$ , where $P_n = V_n \times I_n$
pf	Power factor	$V = V_n, I \geq 0.1 \times I_n, \text{ pf} \geq 0.8$	$\pm 0.05$
F	Frequency	$F = 47.5 \text{ to } 52.5\text{Hz @ } 50\text{Hz}$ and $57 \text{ to } 63\text{Hz @ } 60\text{Hz}$	$\pm 10\text{mHz}$

### 1.3.2 USB 2.0 Data Communication Interface

Attribute	Value
Physical layer	Electrical
Connectors	USB-Type B

### 1.3.3 RS485 Data Communication Interface

Attribute	Value
Physical layer	Electrical
Connectors	4mm Ring Crimp

### 1.3.4 Real Time Clock

#### 1.3.4.1 Internal Clock

The specification below applies only while no external synchronisation signal (e.g. 60870-5-103) is being received.

Attribute	Value
Accuracy (-10 to +55°C)	$\pm 3.5 \text{ p.p.m}$

## 1.4 Environmental Performance

### 1.4.1 General

#### 1.4.1.1 Temperature

IEC 60068-2-1/2

Type	Level
Operating range	-10 °C to +55 °C
Storage range	-25 °C to +70 °C

#### 1.4.1.2 Humidity

IEC 60068-2-78

Type	Level
Operational test	56 days at 40 °C and 93 % relative humidity

#### 1.4.1.3 Transient Overvoltage

IEC 60255-5

Type	Level
Between all terminals and earth, or between any two independent circuits	5.0 kV, 1.2/50 $\mu$ s 0.5j

#### 1.4.1.4 Insulation

IEC 60255-5

Type	Level
Between any terminal and earth	2.5 kV AC RMS for 1 min
Between independent circuits	
Across normally open contacts	1.0 kV AC RMS for 1 min

#### 1.4.1.5 IP Ratings

IEC60529

Type	Level
Installed with cover on	IP 5X, Category 2- Dust-protected
Installed with cover off	IP 4X, 1mm probe

### 1.4.2 Emissions

IEC 60255-25

#### 1.4.2.1 Radiated Emissions: Enclosure

Type	Limits at 10 m, Quasi-peak
30 to 230 MHz	40 dB( $\mu$ V/m)
230 to 1000 MHz	47 dB( $\mu$ V/m)

#### 1.4.2.2 Radiated Emissions: Conducted

Type	Limits	
	Quasi-peak	Average
0.15 to 0.5 MHz	79 dB( $\mu$ V)	66 dB( $\mu$ V)
0.5 to 30 MHz	73 dB( $\mu$ V)	60 dB( $\mu$ V)

### 1.4.3 Immunity

#### 1.4.3.1 Auxiliary Supply Variation IEC 60255-11

Type of Phenomena	Test Specifications	Duration	Declared Operation
Voltage Dips (DC auxiliary supply)	0% RV	50ms (Claimed)	Normal Operation <sup>1</sup>
	40% RV	200ms	Normal operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
	70% RV	500ms	Normal operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
Voltage Dips (AC auxiliary supply)	0% RV	2.5/3 cycles @50/60Hz (claimed)	Normal Operation <sup>1</sup>
	40% RV	10/12 cycles @50/60Hz	Normal Operation <sup>1</sup>
	70% RV	25/30 cycles @50/60Hz	Normal Operation <sup>1</sup>
Voltage Interruptions (DC auxiliary supply)	0% RV	5s	Relay Reset <sup>2</sup>
Voltage Interruptions (AC auxiliary supply)	0% RV	250/300 cycles @50/60Hz	Relay Reset <sup>2</sup>
Alternating Component In DC (Ripple) (DC auxiliary supply)	15% max and min RV	Continuous	Normal operation <sup>1</sup>
Gradual Shut-down/ Start-up (DC auxiliary supply)	Max & min RV to 0V	60s	Relay Reset
	0V	5minutes	Relay Off
	0V to min & max RV	60s	Relay Restart <sup>2</sup>
Reversal of DC Power Supply polarity	Max reversed RV	1minute	24-60 V Dc models: No operation 80-250 V DC, 115 V AC models: Normal Operation <sup>1</sup>

Key:

RV = Residual Voltage Test Value. Two conditions: (a) range voltage low-20% and

(b) range voltage high +20%

<sup>1</sup> No effect on relay performance

<sup>2</sup> Restart with no mal-operation, loss of data or relay damage

#### 1.4.3.2 High Frequency Disturbance

IEC 60255-22-1

Type	Level
Common (longitudinal) mode	2.5 kV

Type	Level
Series (transverse) mode	1.0 kV

## 1.4.3.3 Electrostatic Discharge

IEC 60255-22-2 Class 4

Type	Level	Variation
Contact discharge	8.0 kV	≤ 5 %

## 1.4.3.4 Radiated Immunity

IEC 60255-22-3

Type	Level
80 MHz to 1000 MHz Sweep	10 V/m
1.4GHz to 2.7GHz Sweep	10V/m
80,160,380,450,900,1850,2150 MHz Spot	10V/m

## 1.4.3.5 Fast Transients

IEC 60255-22-4 (2002) Class A

Type	Level
5/50 ns 2.5 kHz repetitive	4kV

## 1.4.3.6 Surge Immunity

IEC 60255-22-5

Type	Level
Between all terminals and earth	0.5, 1.0, 2.0, 4.0 kV
Between Line to Line*	0.5, 1.0, 2.0 kV

\*Note. 45ms pick up delay for DTL applied to binary inputs for DC operation. For AC operation where 0ms pick-up delay is required, screened twisted pair wiring must be used for lengths greater than 10 m.

## 1.4.3.7 Conducted Radio Frequency Interference

IEC 60255-22-6

Type	Level
0.15 to 80 MHz	10 V

## 1.4.3.8 Magnetic Field with Power Frequency

IEC 6100-4-8 Level 5

100A/m, (0.126mT) continuous	50Hz
1000A/m, (1.26mT) for 3s	

## 1.4.4 Mechanical

## 1.4.4.1 Vibration (Sinusoidal)

IEC 60255-21-1 Class I

Type	Level	Variation
Vibration response	0.5 gn	≤ 5 %
Vibration endurance	1.0 gn	

## 1.4.4.2 Shock and Bump

IEC 60255-21-2 Class I

Type	Level	Variation
Shock response	5 gn, 11 ms	≤ 5 %

Type	Level	Variation
Shock withstand	15 gn, 11 ms	
Bump test	10 gn, 16 ms	

## 1.4.4.3 Seismic

IEC 60255-21-3 Class I

Type	Level	Variation
Seismic response	X-plane - 3.5mm displacement below crossover freq (8-9Hz) 1.0gn above	≤ 5 %
	Y-plane - 1.5mm displacement below crossover freq (8-9Hz) 0.5gn above	

## 1.4.4.4 Mechanical Classification

Type	Level
Durability	> 10 <sup>6</sup> operations

## Section 2: Protection Functions

### 2.1 27/59 Under/over voltage

#### 2.1.1 Reference

	Parameter	Value
$V_s$	Setting	5, 5.5...200V
$hyst$	Hysteresis setting	0, 0.1... 80.0%
$t_d$	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

#### 2.1.2 Operate and Reset Level

	Attribute	Value
$V_{op}$	Operate level	100 % $V_s$ , $\pm 1$ % or $\pm 0.25V$
	Reset level	Overvoltage = $(100 \% - hyst) \times V_{op}$ , $\pm 1$ % or $\pm 0.25V$
		Undervoltage = $(100 \% + hyst) \times V_{op}$ $\pm 1$ % or $\pm 0.25V$
	Repeatability	$\pm 1$ %
	Variation	-10 °C to +55 °C $\leq 5$ %
		$f_{nom} \pm 5$ % $\leq 5$ %

#### 2.1.3 Operate and Reset Time

	Attribute	Value
$t_{basicE}$	Element basic operate time	Overvoltage
		0 to 1.1 x $V_s$ : 73 ms or $\pm 10ms$ 0 to 2.0 xVs: 63 ms or $\pm 10ms$
	Undervoltage	1.1 to 0.5 xVs: 58 ms or $\pm 10ms$
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1$ % or $\pm 10ms$
	Repeatability	$\pm 1$ % or $\pm 10ms$
	Disengaging time	< 80 ms

## 2.2 37 Undercurrent

### 2.2.1 Reference

	Parameter	Value
$I_s$	Setting	0.05, 0.10...5.0 xIn
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.2.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\%$ $I_n$
	Reset level	$\leq 105\%$ $I_{op}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$
		$\leq 5\%$
		$\leq 5\%$

### 2.2.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	1.1 to 0.5 x/s: 35 ms or $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms



## 2.3 46NPS Negative Phase Sequence Overcurrent

### 2.3.1 Reference (46DT)

	Parameter	Value
$I_s$	Setting	0.05, 0.06... 4.0xIn
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.3.2 Operate and Reset Level (46DT)

	Attribute	Value
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\%$ In
	Reset level	$\geq 95\%$ $I_{op}$
	Repeatability	$\pm 1\%$
	Transient overreach (X/R $\leq 100$ )	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$

### 2.3.3 Operate and Reset Time (46DT)

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 xIs: 40 ms or $\pm 10$ ms
		0 to 5 xIs: 30 ms or $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	<40 ms
	Disengaging time	< 60 ms

### 2.3.4 Reference (46IT)

	Parameter	Value
<i>char</i>	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
<i>Tm</i>	Time Multiplier setting	1.0
$I_s$	Setting	0.05, 0.06... 2.5xIn
<i>I</i>	Applied Current (for operate time) IDMTL	2 to 20 x Is
$t_d$	Delay setting	0, 0.01... 20 s
$t_{res}$	Reset setting	ANSI DECAYING, 0, 1... 60 s

### 2.3.5 Operate and Reset Level (46IT)

	Attribute	Value
$I_{op}$	Operate level	105 % $I_s$ , $\pm 4\%$ or $\pm 1\%$ In
	Reset level	$\geq 95\%$ $I_{op}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$

## 2.3.6 Operate and Reset Time (46IT)

	Attribute	Value
	Starter operate time ( $\geq 2xI_s$ )	35 ms, $\pm 10$ ms
$t_{op}$	Operate time	$char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = ANSI-MI, ANSI-VI, ANSI-EI$ $t_{op} = \left[ \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5\% \text{ absolute or } \pm 50 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	$char = DTL$	$t_d, \pm 1\% \text{ or } \pm 20\text{ms}$
	Reset time	$ANSI \text{ DECAYING}$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 50 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
		$IEC \text{ DECAYING}$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res}$	$t_{res}, \pm 1\% \text{ or } \pm 20\text{ms}$
	Repeatability	$\pm 1\% \text{ or } \pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms

## 2.4 47 Negative Phase Sequence Voltage

### 2.4.1 Reference (47)

	Parameter	Value
$V_s$	Setting	1, 1.5... 90V
<i>Hyst.</i>	Hysteresis	0, 0.1... 80%
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.4.2 Operate and Reset Level (47)

	Attribute	Value
$V_{op}$	Operate level	100 % $V_s$ , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$(100\% - \text{Hyst.}) \times V_{op} \pm 1\%$ or $\pm 0.25\text{ V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$

### 2.4.3 Operate and Reset Time (47)

	Attribute	Value
$t_{basic}$	Element basic operate time	0V to 2.0 x $V_s$ , 80 ms or $\pm 20\text{ ms}$
		0V to 10 x $V_s$ , 70ms or $\pm 20\text{ ms}$
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 2\%$ or $\pm 20\text{ ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 90 ms

## 2.5 49 Thermal Overload

### 2.5.1 Reference

	Parameter	Value
$I_s$	Overload setting	1.0 x $I_n$
$i$	Applied Current (for operate time)	1.2 to 10 x $I_s$
$\tau$	Time constant setting	1, 10, 100, 1000 min

### 2.5.2 Operate and Reset Level

	Attribute	Value	
$I_{ol}$	Overload level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\% I_n$	
	Reset level	$\geq 95\% I_{ol}$	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$

### 2.5.3 Operate and Reset Time

	Attribute	Value
$t_{op}$	Overload trip operate time	$t = \tau \times \ln \left\{ \frac{I^2 - I_p^2}{I^2 - (k \times I_B)^2} \right\}$ , $\pm 5\%$ absolute or $\pm 100\text{ms}$ , where $I_p$ = prior current
	Repeatability	$\pm 100\text{ms}$
Note:- Fastest operate time is at 10 x $I_s$		

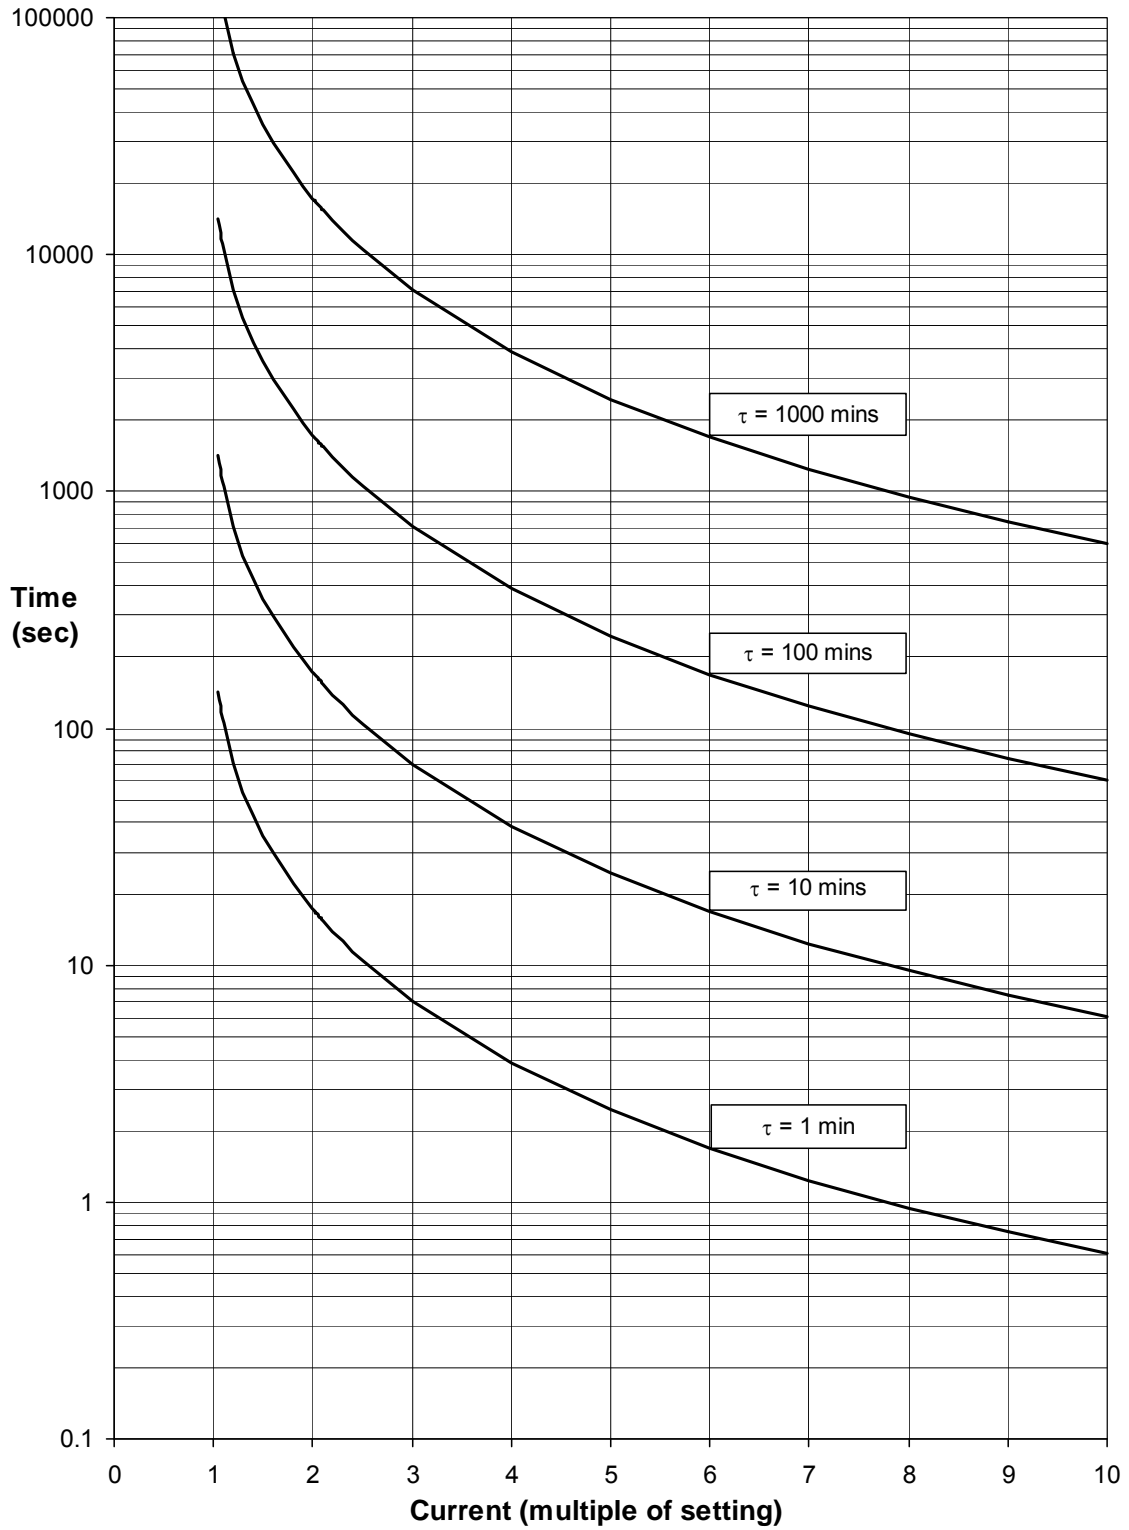


Figure 2.5-1 Thermal Overload Protection Curves

## 2.6 50 Instantaneous Overcurrent

### 2.6.1 Reference

	Parameter	Value
$I_s$	Setting	0.05, 0.06... 2.5, 2.55... 50 $\times I_n$
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.6.2 Operate and Reset Level

	Attribute	Value	
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\% I_n$	
	Reset level	$\geq 95\% I_{op}$	
	Repeatability	$\pm 1\%$	
	Transient overreach ( $X/R \leq 100$ )	$\leq -5\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$

### 2.6.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 $\times I_s$ : 35 ms or $\pm 10$ ms
		0 to 5 $\times I_s$ : 25 ms or $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	$< 40$ ms
	Disengaging time	$< 50$ ms

## 2.7 50G Instantaneous Measured Earth Fault

### 2.7.1 Reference

	Parameter	Value
$I_s$	Setting	0.05, 0.06...2.5, 2.55 ...25.0, 25.5... 50 $\times I_n$
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.7.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\geq 95\% I_{op}$
	Repeatability	$\pm 1\%$
	Transient overreach ( $X/R \leq 100$ )	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$
		$\leq 5\%$
		$\leq 5\%$

### 2.7.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 $\times I_s$ : 35 ms or $\pm 10$ ms
		0 to 5 $\times I_s$ : 25 ms or $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	$< 40$ ms
	Disengaging time	$< 50$ ms

## 2.8 50N Instantaneous Derived Earth Fault

### 2.8.1 Reference

	Parameter	Value
$I_s$	Setting	0.05, 0.06...2.5, 2.55 ...25.0, 25.5... 50 $\times I_n$
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.8.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\geq 95\% I_{op}$
	Repeatability	$\pm 1\%$
	Transient overreach ( $X/R \leq 100$ )	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$
		$\leq 5\%$
		$\leq 5\%$

### 2.8.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 $\times I_s$ : 40 ms or $\pm 10$ ms
		0 to 5 $\times I_s$ : 30 ms or $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	$< 40$ ms
	Disengaging time	$< 50$ ms



## 2.9 50SEF Instantaneous Sensitive Earth Fault

### 2.9.1 Reference

	Parameter	Value
$I_s$	Setting	0.005, 0.006, 0.010, 0.105, ... 5.0 xIn
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.9.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\%$ In
	Reset level	$\geq 95\%$ $I_{op}$ or $I_{op} - 0.1\%$ In
	Repeatability	$\pm 1\%$
	Transient overreach (X/R $\leq 100$ )	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$
		harmonics to $f_{cutoff}$
		$\leq 5\%$
		$\leq 5\%$

### 2.9.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 xIs: 35 ms or $\pm 10ms$
		0 to 5 xIs: 25 ms or $\pm 10ms$
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10ms_e$
	Repeatability	$\pm 1\%$ or $\pm 10ms$
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms
	Variation	$f_{nom} \pm 5\%$
		$\leq 5\%$

## 2.10 51 Time Delayed Overcurrent

### 2.10.1 Reference

	Parameter	Value
$I_s$	Setting	0.05, 0.06... 2.5 x $I_n$
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
$T_m$	Time Multiplier setting	1.0 (0.025, 0.05...100)
$t_d$	Delay setting	0, 0.01... 20 s
$t_{res}$	Reset setting	ANSI DECAIVING, 0, 1... 60 s
$I$	Applied Current (for operate time)	IDMTL 2 to 20 x $I_s$
		DTL 5 x $I_s$

### 2.10.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	105 % $I_s$ , $\pm 4$ % or $\pm 1$ % $I_n$
	Reset level	$\geq 95$ % $I_{op}$
	Repeatability	$\pm 1$ %
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5$ %

### 2.10.3 Operate and Reset Time

	Attribute	Value
	Starter operate time ( $\geq 2x/s$ )	20 ms, $\pm 20$ ms
$t_{op}$	Operate time	$char = \text{IEC-NI, IEC-VI, IEC-EI, IEC-LTI}$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times T_m, \pm 5$ % absolute or $\pm 30$ ms, for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = \text{ANSI-MI, ANSI-VI, ANSI-EI}$ $t_{op} = \left[ \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times T_m, \pm 5$ % absolute or $\pm 30$ ms, for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
		$char = \text{DTL}$
	Reset time	$ANSI \text{ DECAIVING}$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times T_m, \pm 5$ % absolute or $\pm 30$ ms, for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1

Attribute		Value
	IEC DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res}$	$t_{res}, \pm 1 \% \text{ or } \pm 20\text{ms}$
	Repeatability	$\pm 1 \% \text{ or } \pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms

Figure 2.10-1 and 2.10-4 shows the operate and reset curves for the four IEC IDMTL curves with a time multiplier of 1.

Figs 2.10-2 and 2.10-3 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

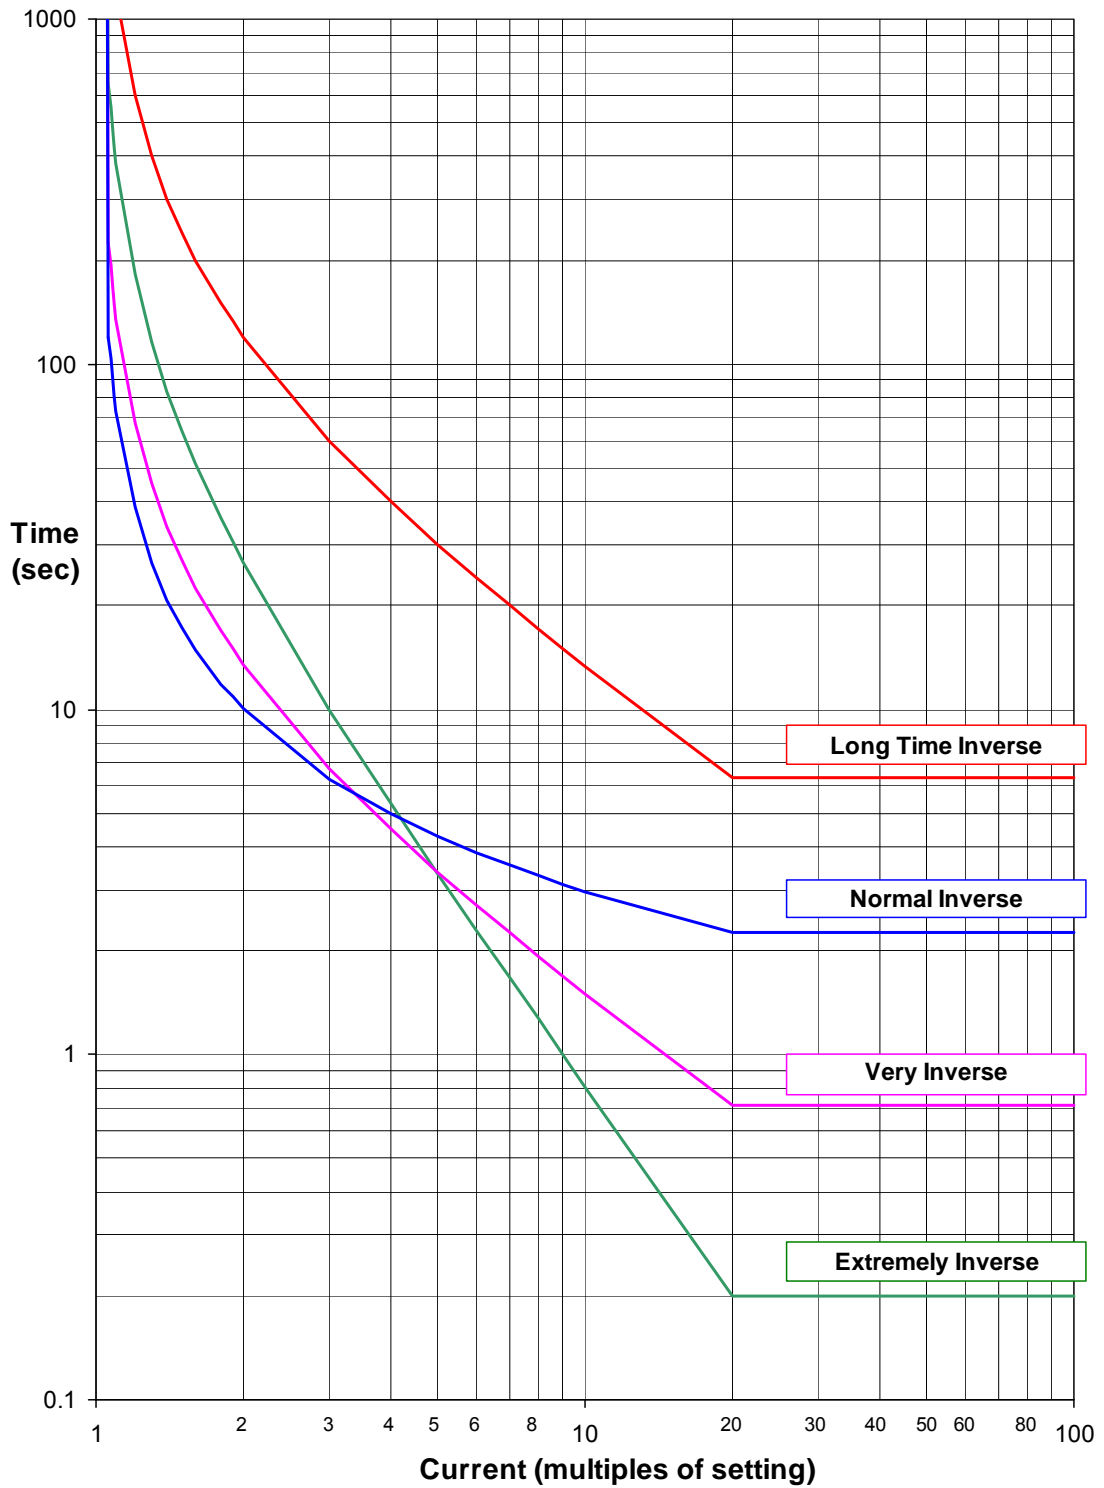


Figure 2.10-1 IEC IDMTL Curves (Time Multiplier=1)

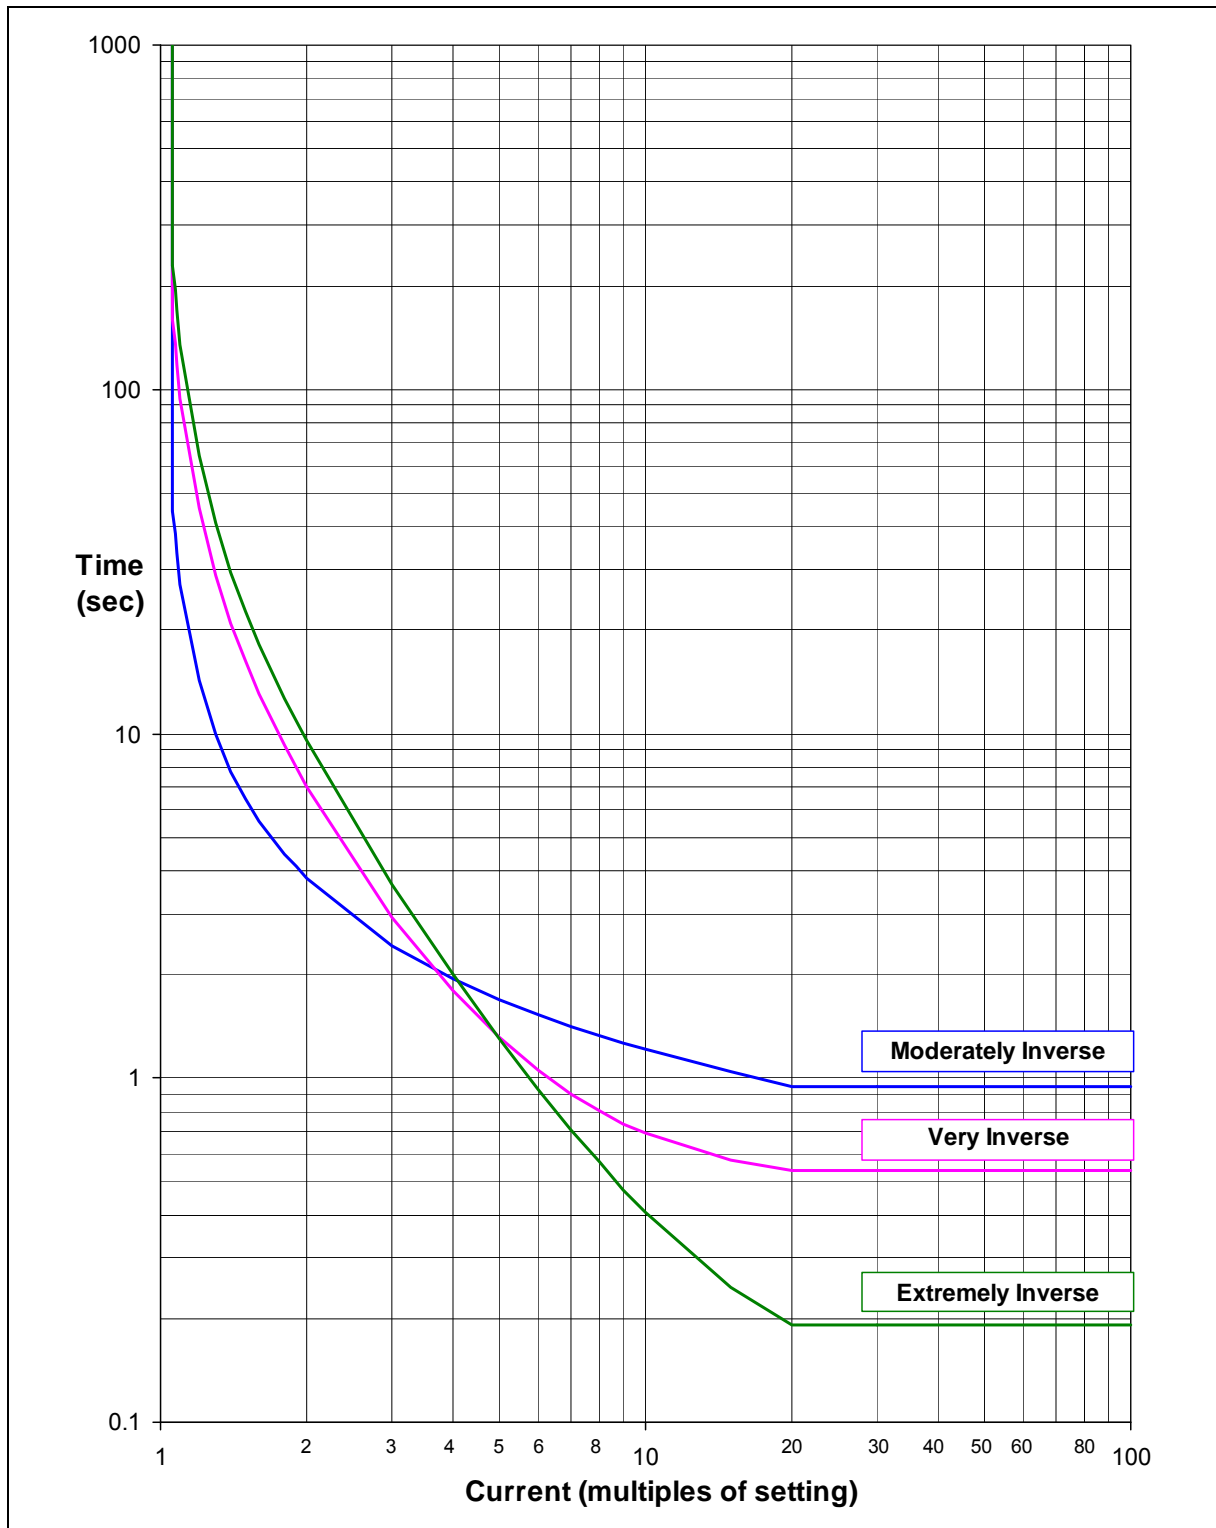


Figure 2.10-2 ANSI IDMTL Operate Curves (Time Multiplier=1)

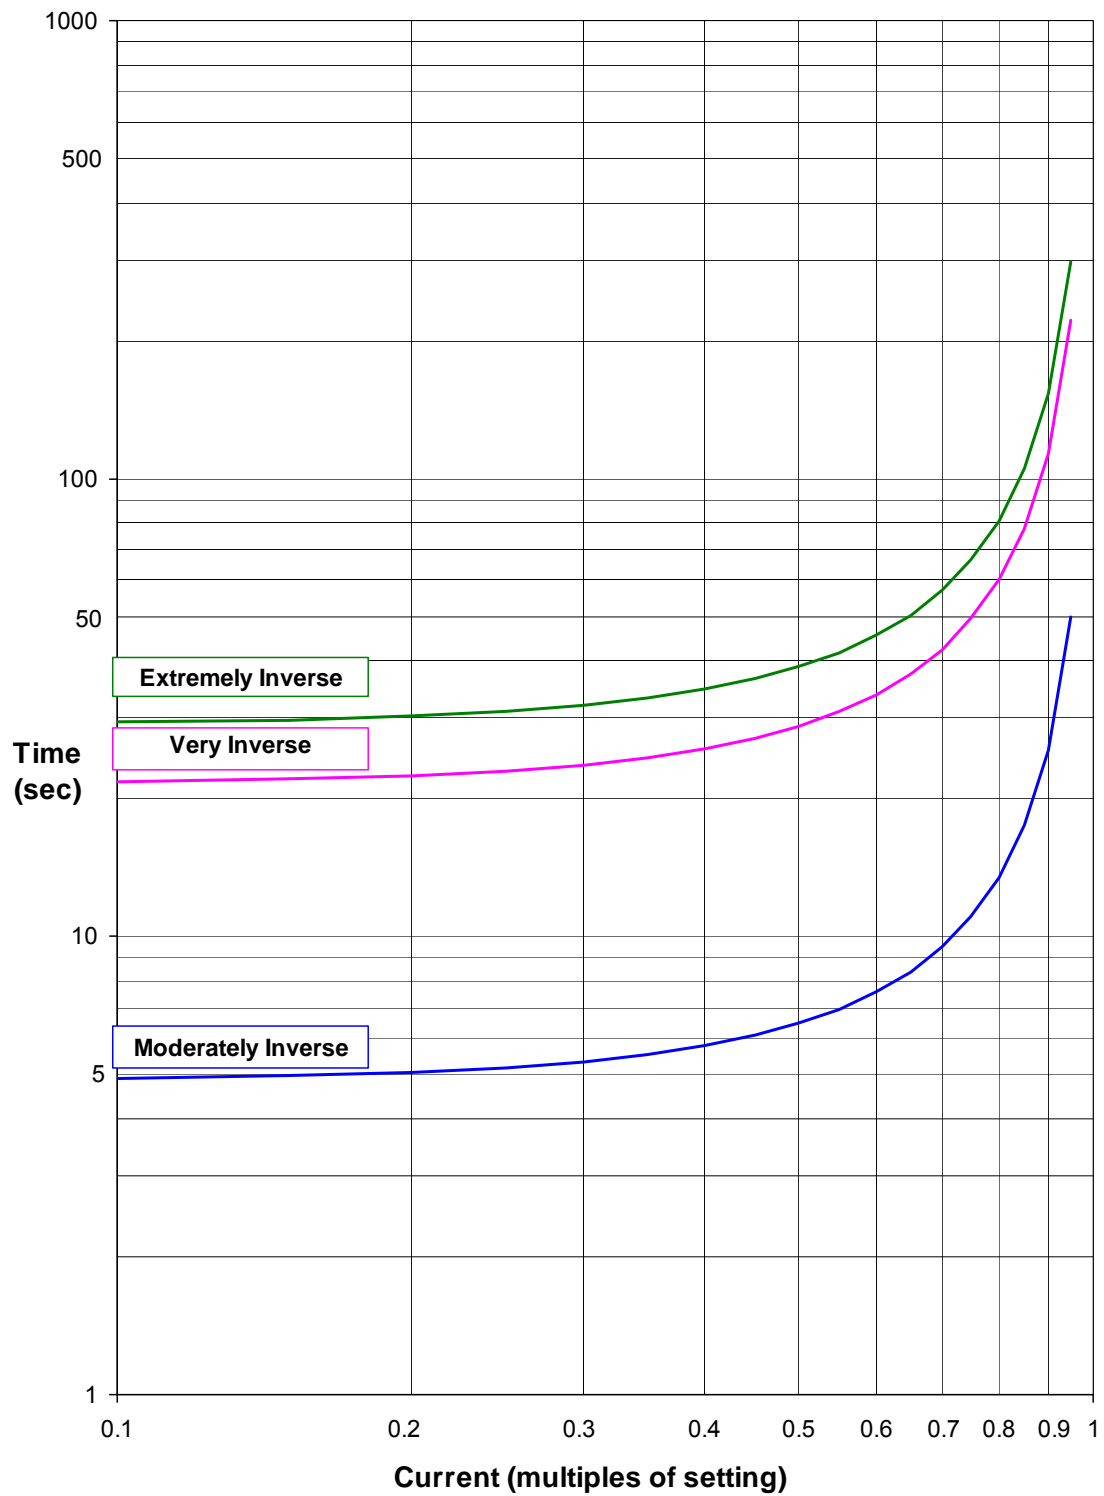


Figure 2.10-3 ANSI Reset Curves (Time Multiplier=1)

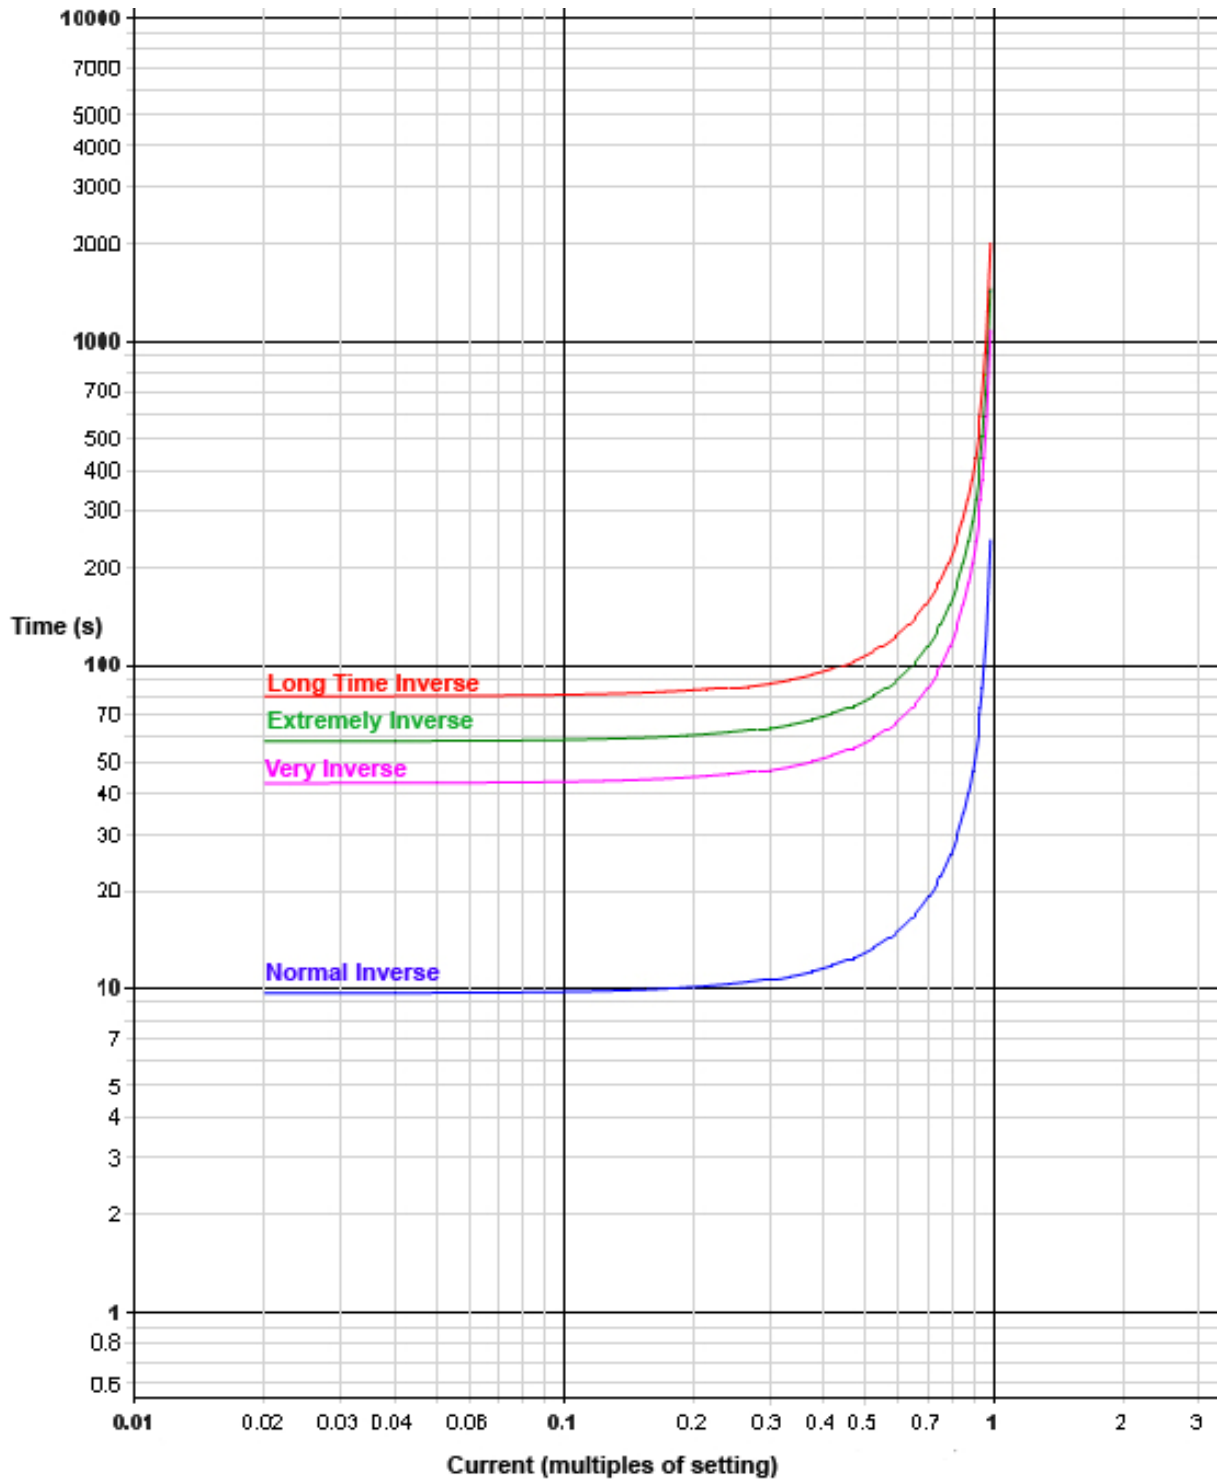


Figure 2.10-4 IEC Reset Curves (Time Multiplier=1)

## 2.11 51G Time Delayed Measured Earth Fault

### 2.11.1 Reference

	Parameter	Value	
$I_s$	Setting	0.05, 0.06... 2.5 xIn	
Char	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
$T_m$	Time Multiplier setting	1.0 (0.025,0.05...100)	
$t_d$	Delay setting (DTL)	0, 0.01... 20 s	
$t_{res}$	Reset setting	ANSI DECAYING, 0, 1... 60 s	
$I$	Applied current (for operate time)	IDMTL	2 to 20 x/s
		DTL	5 x/s

### 2.11.2 Operate and Reset Level

	Attribute	Value	
$I_{op}$	Operate level	105 % $I_s$ , $\pm 4$ % or $\pm 1$ % $I_n$	
	Reset level	$\geq 95$ % $I_{op}$	
	Repeatability	$\pm 1$ %	
	Variation	-10 °C to +55 °C	$\leq 5$ %
		$f_{nom} \pm 5$ %	$\leq 5$ %

### 2.11.3 Operate and Reset Time

	Attribute	Value
	Starter operate time ( $\geq 2x/s$ )	20 ms, $\pm 20$ ms
$t_{op}$	Operate time	$char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times T_m, \pm 5 \text{ \% absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = ANSI-MI, ANSI-VI, ANSI-EI$ $t_{op} = \left[ \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times T_m, \pm 5 \text{ \% absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
		$char = DTL$ $t_d, \pm 1 \text{ \% or } \pm 20\text{ms}$
	Reset time	$ANSI DECAYING$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^P - 1} \times T_m, \pm 5 \text{ \% absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1



Attribute		Value
	IEC DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res}$	$t_{res}, \pm 1 \% \text{ or } \pm 20\text{ms}$
	Repeatability	$\pm 1 \% \text{ or } \pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms

Figure 2.10-1 and 2.10-4 shows the operate and reset curves for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2.10-2 and 2.10-3 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

## 2.12 51N Time Delayed Derived Earth Fault

### 2.12.1 Reference

	Parameter	Value	
$I_s$	Setting	0.05, 0.6... 2.5 xIn	
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
$Tm$	Time Multiplier setting	1.0 (0.025, 0.05... 100)	
$t_d$	Delay setting	0, 0.01... 20 s	
$t_{res}$	Reset setting	ANSI DECAIVING, 0, 1... 60 s	
$I$	Applied Current (for operate time)	IDMTL	2 to 20 x Is
		DTL	5 x Is

### 2.12.2 Operate and Reset Level

	Attribute	Value	
$I_{op}$	Operate level	105 % $I_s$ , $\pm 4$ % or $\pm 1$ % $I_n$	
	Reset level	$\geq 95$ % $I_{op}$	
	Repeatability	$\pm 1$ %	
	Variation	-10 °C to +55 °C	$\leq 5$ %
		$f_{nom} \pm 5$ %	$\leq 5$ %

### 2.12.3 Operate and Reset Time

	Attribute	Value
	Starter operate time ( $\geq 2xI_s$ )	30 ms, $\pm 20$ ms
$t_{op}$	Operate time	$char =$ IEC-NI, IEC-VI, IEC-EI, IEC-LTI $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5$ % absolute or $\pm 30$ ms, for $char =$ IEC-NI : $K = 0.14, \alpha = 0.02$ IEC-VI : $K = 13.5, \alpha = 1.0$ IEC-EI : $K = 80.0, \alpha = 2.0$ IEC-LTI : $K = 120.0, \alpha = 1.0$
		$char =$ ANSI-MI, ANSI-VI, ANSI-EI $t_{op} = \left[ \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5$ % absolute or $\pm 30$ ms, for $char =$ ANSI-MI : $A = 0.0515, B = 0.114, P = 0.02$ ANSI-VI : $A = 19.61, B = 0.491, P = 2.0$ ANSI-EI : $A = 28.2, B = 0.1217, P = 2.0$
		$char =$ DTL $t_d, \pm 1$ % or $\pm 20$ ms
	Reset time	$ANSI DECAIVING$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5$ % absolute or $\pm 30$ ms, for $char =$ ANSI-MI : $R = 4.85$ ANSI-VI : $R = 21.6$ ANSI-EI : $R = 29.1$

Attribute		Value
	IEC DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res}$	$t_{res}, \pm 1 \% \text{ or } \pm 20\text{ms}$
	Repeatability	$\pm 1 \% \text{ or } \pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms

Figure 2.10-1 and 2.10-4 shows the operate and reset curves for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2.10-2 and 2.10-3 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

## 2.13 51SEF Time Delayed Sensitive Earth Fault

### 2.13.1 Reference

	Parameter	Value	
$I_s$	Setting	0.005, 0.006, 0.010, 0.105, ... 5.0 x $I_n$	
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
$T_m$	Time multiplier	1.0 (0.025, 0.05...100)	
$t_d$	Delay setting	0.00...20.00 s	
$t_{res}$	Reset setting	DECAYING, 0, 1...60 s	
$I$	Applied Current (for operate time)	IDMTL	2 to 20 x $I_s$
		DTL	5 x $I_s$

### 2.13.2 Operate and Reset Level

	Attribute	Value	
$I_{op}$	Operate level	105 % $I_s$ , $\pm 4\%$ or $\pm 1\%$ $I_n$	
	Reset level	95 % $I_{op} \pm 4\%$ or $\pm 1\%$ $I_n$	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$
		harmonics to $f_{cutoff}$	$\leq 5\%$

### 2.13.3 Operate and Reset Time

	Attribute	Value
	Starter operate time	20 ms, $\pm 20ms$
$t_{op}$	Operate time	$t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times T_m, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$t_{op} = \left[ \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times T_m, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	char = DTL	$t_d, \pm 1\%$ or $\pm t_{cycle}$

Attribute		Value
Reset time	char = ANSI and $t_{res}$ = DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
	IEC DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \% \text{ absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res} \neq$ DECAYING	$t_{res}, \pm 1 \% \text{ or } \pm 20ms$
Repeatability		$\pm 1 \% \text{ or } \pm 20ms$
Overshoot time		< 40 ms
Disengaging time		< 50 ms
Variation	$f_{nom} \pm 5 \%$ harmonics to $f_{cutoff}$	$\leq 5 \%$

Figure 2.10-1 shows the operate times for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2.10-2 and 2.10-3 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

## 2.14 51V Voltage Controlled Overcurrent

### 2.14.1 Reference

	Parameter	Value
$V_s$	Setting	60V
$m$	multiplier	0.5
$I_s$	Setting	1xIn

### 2.14.2 Operate and Reset Level

	Attribute	Value
$V_{op}$	Operate level	100 % $V_s$ , $\pm 1$ % or $\pm 0.25V$
	Reset level	$\leq 105$ % $V_{op}$
	Repeatability	$\pm 1$ %
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5$ % harmonics to $f_{cutoff}$
		$\leq 5$ %

#### Operate and Reset Time

As per Phase Fault Shaped Characteristic Element (ANSI 51).

Where Pickup Level =  $I_s$  for Voltage >  $V_s$

Pickup Level = ( $I_s \times m$ ) for Voltage <  $V_s$

## 2.15 59N Neutral Voltage Displacement

### 2.15.1 Reference (59NDT)

	Parameter	Value
$V_s$	Setting	0.1 x $V_n$
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

### 2.15.2 Operate and Reset Level (59NDT)

	Attribute	Value
$V_{op}$	Operate level	100 % $V_s$ , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$\geq 95\%$ $V_{op}$ or $\pm 0.5\text{ V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$

### 2.15.3 Operate and Reset Time (59NDT)

	Attribute	Value
$t_{basic}$	Element basic operate time	0V to 1.5 x $V_s$ , 76 ms, $\pm 20\text{ms}$
		0V to 10 x $V_s$ , 63 ms, $\pm 20\text{ms}$
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 20\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	<100 ms

### 2.15.4 Reference (59NIT)

	Parameter	Value
$M$	Multiplier setting	1
$V_s$	Setting	1, 1.5... 100V
$3V_o$	Applied Current (for Operate-Time) IDMTL	2 x $V_s$
$t_d$	Delay setting	0, 0.01... 20 s
$t_{res}$	Reset setting	0, 1...60 s

### 2.15.5 Operate and Reset Level (59NIT)

	Attribute	Value
$V_{op}$	Operate level	105 % $V_s$ , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$\geq 95\%$ $V_{op}$ or $\pm 0.5\text{ V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$

#### Operate and Reset Time (59NIT)

	Attribute	Value
$t_{basic}$	Starter operate time	65 ms, $\pm 20\text{ms}$
$3V_o$	Applied Current (for Operate-Time) DTL	10 x $V_s$

	Attribute		Value
$t_{op}$	Operate time	char = IDMTL	$t_{op} = \frac{M}{\left[\frac{3V_0}{V_s}\right] - 1}, \pm 5\% \text{ or } \pm 65 \text{ ms}$
		char = DTL	$t_d, \pm 1\% \text{ or } \pm 40\text{ms}$
	Reset Time	char = IDMTL	$t_{res}, \pm 5\% \text{ or } \pm 65\text{ms}$
		char = DTL	$t_{res}, \pm 1\% \text{ or } \pm 40\text{ms}$
	Repeatability		$\pm 1\% \text{ or } \pm 20\text{ms}$
	Overshoot time		$< 40 \text{ ms}$
	Disengaging time		$< 100 \text{ ms}$



## 2.16 64H Restricted Earth Fault Protection

### 2.16.1 Reference

	Parameter	Value	
$I_s$	Setting	SEF Input	0.005, 0.006 ... 0.100, 0.105 ... 0.950 $xI_n$
		EF Input	0.05, 0.055... 0.95 $xI_n$
$t_d$	Delay setting	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s	

### 2.16.2 Operate and Reset Level

	Attribute	Value	
$I_{op}$	Operate level	100 % $I_s$ , $\pm 5\%$ or $\pm 1\% xI_n$	
	Reset level	95 % $I_{op}$ , $\pm 5\%$ or $\pm 0.1\% xI_n$	
	Repeatability	$\pm 1\%$	
	Transient overreach ( $X/R \leq 100$ )	$\leq -5\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$

### 2.16.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	0 to 2 $xI_s$ , 45 ms, $\pm 10$ ms
		0 to 5 $xI_s$ , 35 ms, $\pm 10$ ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms

## 2.17 67/67N Directional Overcurrent & Earth Fault

### 2.17.1 Reference

	Parameter	Value
$\theta_s$	Angle setting	-95...+95 °
$I$	Applied current	$I_n$
$V$	Applied voltage	110 V phase-phase (63.5 V phase-earth)

### 2.17.2 Operate Angle

	Attribute	Value
CA	Characteristic angle (I with respect to V)	$\theta_s, \pm 5^\circ$
	Operating angle	forward $CA - 85^\circ \pm 5^\circ$ to $CA + 85^\circ \pm 5^\circ$
		reverse $(CA - 180^\circ) - 85^\circ \pm 5^\circ$ to $(CA - 180^\circ) + 85^\circ \pm 5^\circ$
	Variation in characteristic angle	10°C to +55°C $\pm 5^\circ$
		$f_{nom} \pm 5\%$ $\pm 5^\circ$

### 2.17.3 Operate Threshold

	Attribute	Value
	Minimum levels for operation	I (p/f) > 5 % $I_n$
		I (e/f) > 10 % $I_n$
		V (p/f) > 1 V
		V (e/f) > 1 V

### 2.17.4 Operate and Reset Time

	Attribute	Value
	Operate time	typically 32 < 40 ms at characteristic angle + element operate time
	Reset time	typically < 65 ms at characteristic angle

## 2.18 Directional SEF - Wattmetric

### 2.18.1 Reference

	Parameter	Value
$P_o$	Setting	0.05, 0.10, ... 20.0 xInxW (Where In = 1A or 5A )
$I$	Applied current @ In = 1A	10mA...5A
$V$	Applied voltage	10V...200V
$\theta$	Angle	<87.5deg
CA	67SEF Char Angle ( $\theta_c$ )	0
$f$	Nominal	50/60Hz

### 2.18.2 Operate and Reset Level

	Attribute	Value
$P_{op}$	Operate level	100 % $P_o$ , $\pm 25$ % or $\pm 25$ mW
	Reset level	$\geq 95$ % $P_{op}$
	Variation	-10 °C to +55 °C $\leq 5$ %

### 2.18.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	<50ms
	Repeatability	$\pm 1$ % or $\pm 10$ ms

## 2.19 81 Under/over frequency

### 2.19.1 Reference

	Parameter	Value
$F_s$	Setting	43, 43.01... 68 Hz
$Hyst$	Hysteresis setting	0, 0.1... 2%
$t_d$	Delay setting	0.00, 0.01... 20.0, 20.1... 100.0, 101...1000, 1010 ... 10000 , 10100 ... 14400 s

### 2.19.2 Operate and Reset Level

	Attribute	Value
$F_{op}$	Operate level	100 % $F_s$ , $\pm 10\text{mHz}$
	Reset level	overfrequency (100 % - $hyst$ ) $\times F_{op}$ , $\pm 10\text{mHz}$
		underfrequency (100 % + $hyst$ ) $\times F_{op}$ , $\pm 10\text{mHz}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C $\leq 5\%$

### 2.19.3 Operate and Reset Time

	Attribute	Value	
$t_{basic}$	Element basic operate time (for ROCOF between 1 and 5.0 Hz/sec)	overfrequency	Typically < 110ms Maximum < 150ms
		underfrequency	Typically < 110ms Maximum < 150ms
	Element basic operate time (for ROCOF between 0.1 and 1.0 Hz/sec)	overfrequency	Typically < 150ms Maximum < 200ms
		underfrequency	Typically < 150ms Maximum < 200ms
	$t_{op}$	Operate time following delay	$t_{basic} + t_d$ , $\pm 1\%$ or $\pm 10\text{ms}$
		Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Disengaging time	< 100 ms	

## Section 3: Supervision Functions

### 3.1 46BC Broken Conductor

#### 3.1.1 Reference

	Parameter	Value
	NPS to PPS ratio	20,21...100%
$t_f$	Delay setting	0.03,04,20.0,20.1,100,101,1000,1010.....14400 s

#### 3.1.2 Operate and Reset Level

	Attribute	Value
$I_{curr}$	Operate level	100 % $I_{set} \pm 5 \%$
	Reset level	90 % $I_{curr} \pm 5 \%$
	Repeatability	$\pm 1 \%$
	Variation	-10 °C to +55 °C $f_{nom} \pm 5 \%$ harmonics to $f_{cutoff}$
		$\leq 5 \%$

#### 3.1.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Basic operate time   1x In to 0 A	40 ms
	Operate time	$t_f + t_{basic} \pm 1 \%$ or $\pm 20ms$
	Repeatability	$\pm 1 \%$ or $\pm 20ms$
	Variation	$f_{nom} \pm 5 \%$ harmonics to $f_{cutoff}$ $\leq 5 \%$

## 3.2 50BF Circuit Breaker Fail

### 3.2.1 Reference

	Parameter	Value
$I_S$	Setting	0.050, 0.055... 2.0 xIn
$I_4$	Setting	0.050, 0.055... 2.0 xIn
$t_{CBF1}$	Stage 1 Delay setting	20, 25... 60000ms
$t_{CBF2}$	Stage 2 Delay setting	20, 25... 60000ms

### 3.2.2 Operate and Reset Level

	Attribute	Value
$I_{op}$	Operate level	100 % $I_S$ , $\pm 5\%$ or $\pm 1\%$ In
$I_{reset}$	Reset level	<100 % $I_{op}$ , $\pm 5\%$ or $\pm 1\%$ In
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5\%$
		$\leq 5\%$
		$\leq 5\%$

### 3.2.3 Operate and Reset Time

	Attribute	Value
$t_{op}$	Stage 1	$t_{CBF1}$ , $\pm 1\%$ or $\pm 20$ ms
	Stage 2	$t_{CBF2}$ , $\pm 1\%$ or $\pm 20$ ms
	Repeatability	$\pm 1\%$ or $\pm 20$ ms
	Overshoot	< 2 x 20ms
	Disengaging time	< 20ms

### 3.3 60CTS & 60CTS-I Current Transformer Supervision

#### 3.3.1 Reference

	Parameter	Value	
$I_{thresh}$	Current Threshold	0.05, 0.1... 2 xIn	
$I$	Applied Current (for operate time)	Healthy CT Phases	$5 \times I_{thresh}$
		Failed CT phase	0
$t_d$	Delay setting	0.3, 20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s	
Directional Relays have additional VT settings			
$V_{thresh}$	Voltage Threshold	7, 8... 110V	

#### 3.3.2 Current & Voltage Threshold

	Attribute	Value	
$I_{op}$	CT failed current level	100 % $I_{thresh}$ , $\pm 5\%$ or $\pm 1\%$ In	
	Reset level	90 % $I_{op}$ , $\pm 5\%$ or $\pm 1\%$ In	
$V_{op}$	CT failed voltage level	100 % $V_{thresh}$ , $\pm 2\%$ or $\pm 0.5V$	
	Reset level	110 % $V_{op}$ , $\pm 2\%$ or $\pm 0.5V$	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$
		harmonics to $f_{cutoff}$	$\leq 5\%$

#### 3.3.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Basic operate time	50 ms $\pm 20$ ms
	Operate time	$t_d + t_{basic}$ , $\pm 1\%$ or $\pm 20$ ms
	Repeatability	$\pm 1\%$ or $\pm 20$ ms

### 3.4 60VTS Voltage Transformer Supervision

#### 3.4.1 Reference

	Parameter	Value
$V_{nps}$	Vnps Level	7, 8 ... 110V
$I_{nps}$	Inps Level	0.05, 0.1 ... 1 x In
$I_{pps}$	Ipps Load Level	0.05, 0.1 ... 1 x In
$I_{Fpps}$	Ipps Fault Level	0.05, 0.1 ... 20 x In
$V_{pps}$	Vpps Level	1, 2 ... 110V
$t_d$	60VTS Delay	0.00, 0.01...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

#### 3.4.2 Operate and Reset Level

	Attribute	Value	
$V_{NPSop}$	Voltage NPS operate level	100 % $V_{nps}$ , $\pm 5\%$ $V_n$	
	Voltage NPS reset level	90 % $V_{NPSop}$ , $\pm 5\%$ $V_n$	
$V_{PPSop}$	Voltage PPS operate level	100 % $V_{pps}$ , $\pm 5\%$ $V_n$	
	Voltage PPS reset level	110 % $V_{PPSop}$ , $\pm 5\%$ $V_n$	
$I_{NPSblk}$	Current NPS operate level	100 % $I_{nps}$ , $\pm 5\%$ $xIn$	
	Current NPS reset level	90 % $I_{NPSblk}$ , $\pm 5\%$ $xIn$	
$I_{PPSblk}$	Current PPS operate level	100 % $I_{Fpps}$ , $\pm 5\%$ $xIn$	
	Current PPS reset level	90 % $I_{PPSblk}$ , $\pm 5\%$ $xIn$	
$I_{PPSload}$	Current PPS operate level	100 % $I_{pps}$ , $\pm 5\%$ $xIn$	
	Current PPS reset level	90 % $I_{PPSload}$ , $\pm 5\%$ $xIn$	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} \pm 5\%$	$\leq 5\%$

#### 3.4.3 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Basic operate time	0V to 2 x Vs
		32 ms $\pm 10$ ms
	Operate time	$t_d + t_{basic} \pm 1\%$ or $\pm 10$ ms
	Repeatability	$\pm 1\%$ or $\pm 10$ ms



### 3.5 74TCS & 74CCS Trip & Close Circuit Supervision

#### 3.5.1 Reference

	Parameter	Value
$t_d$	Delay setting	0, 0.02...60 s

#### 3.5.2 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	30ms $\pm$ 10ms
$t_{op}$	Operate time following delay	$t_{basic} + t_d, \pm 1 \%$ or $\pm 10$ ms
	Repeatability	$\pm 1 \%$ or $\pm 10$ ms
	Variation	-10 °C to +55 °C
		$f_{nom} \pm 5 \%$
		$\leq 5 \%$
		$\leq 5 \%$

### 3.6 81HBL2 Inrush Detector

#### 3.6.1 Reference

	Parameter	Value
$I$	Setting (Ratio of 2nd Harmonic current to Fundamental component current)	0.10, 0.11... 0.5

#### 3.6.2 Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	Will pick-up before operation of any protection element due to magnetic inrush
	Reset Time	Will operate until drop-off of any protection element due to magnetic inrush