


IF IN DOUBT ASK
DO NOT SCALE

- NOTES
- TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.
 - FOR OUTLINE & DRILLING DRG SEE 2995X10013 (A4).
 - IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

| SUPPLIER | AMP | CABLE SIZE |
|----------|--------|----------------|
| AMP | 342103 | 0.25-1.6 SQ MM |
| AMP | 342143 | 1.0-2.6 SQ MM. |

OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

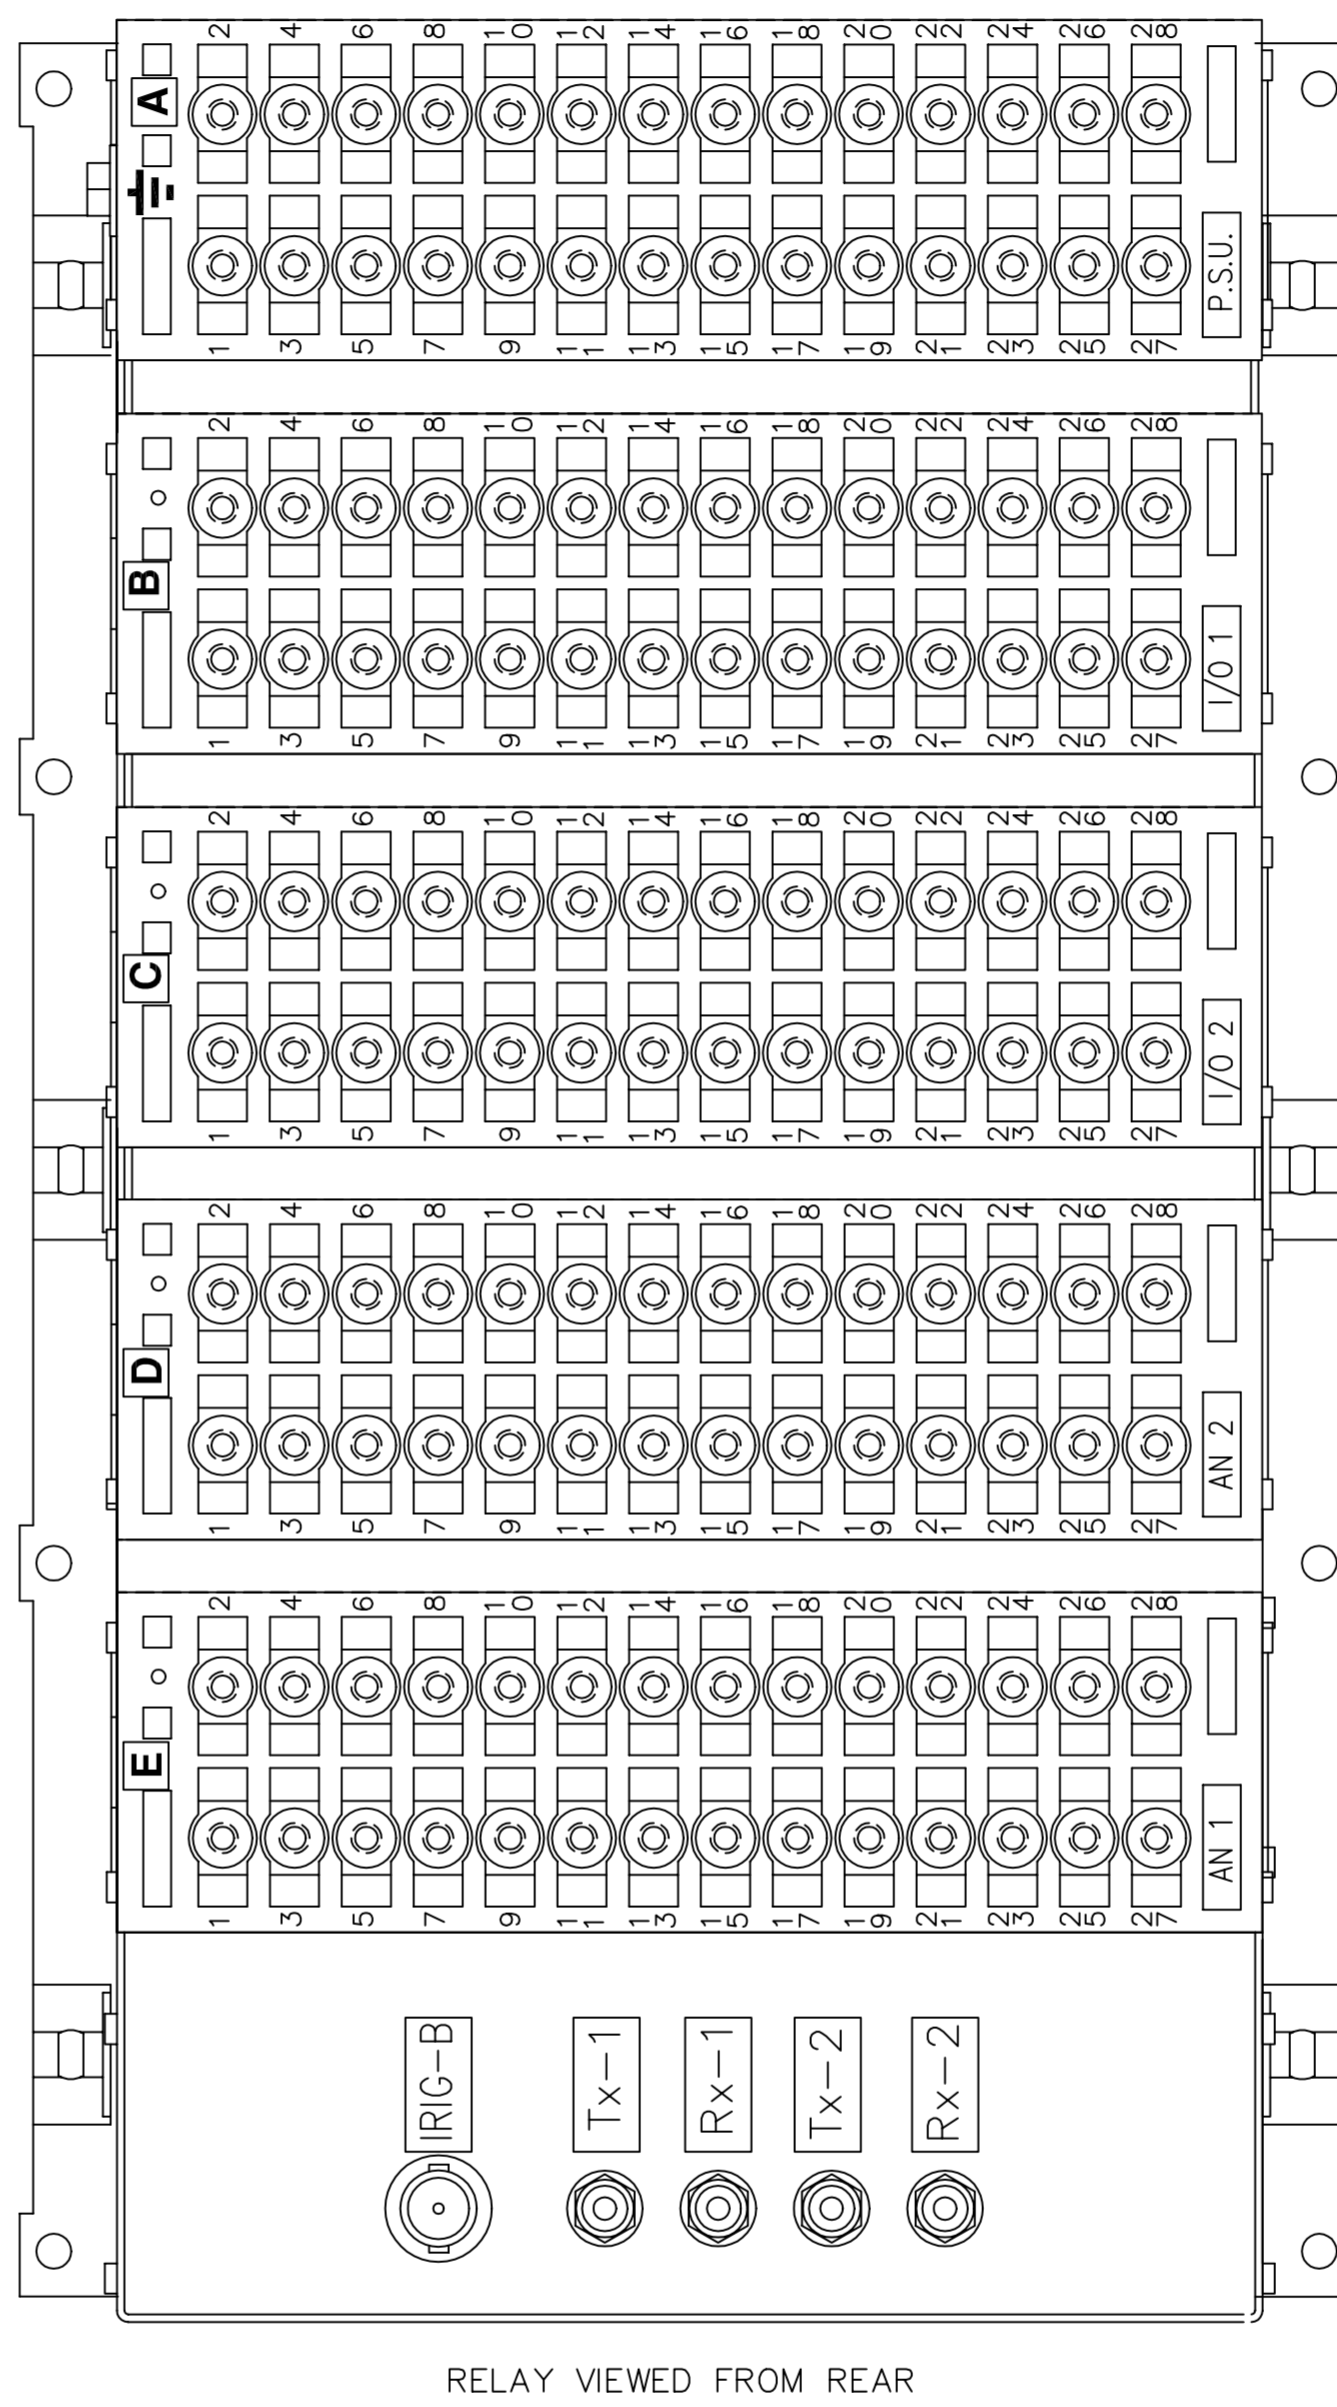

RELAY VIEWED FROM REAR

| MODULE LABEL KEY | |
|---------------------------|-----------|
| ANALOGUE MODULE | AN 1 etc |
| INPUT/OUTPUT MODULE | I/O 1 etc |
| P.S.U. & BASIC I/O MODULE | P.S.U. |

| ABBREVIATIONS | |
|---------------|---------------------------------|
| CT | CURRENT INPUTS |
| VT | VOLTAGE INPUTS |
| SI | STATUS INPUTS |
| CO | CHANGE OVER OUTPUT CONTACTS |
| NO | NORMALLY OPEN OUTPUT CONTACTS |
| NC | NORMALLY CLOSED OUTPUT CONTACTS |

MATERIAL:
 Dimensions in millimetres : Surface texture in micrometres.
 Machine where marked ✓
 For explanation of dimensions, tolerances, notes etc. see B.S.308.
 Limit on untoleranced unmachined dimensions ±
 Limits on untoleranced machined dimensions to B.S.4500;
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
 over 6 to 30±0.2; over 120 to 315±0.5;
 General unmachined angular tolerance ±

| | | |
|---|--|---------------------|
| Finish: | Title: | First used on: |
| Treatment: | TERMINAL I.D. & WRING FOR FM1-2XX-XC (4CT,4VT,19SI,3CO,18NO) IN E12 VERTICAL CASE | Similar Articles: |
| VATECH REYROLLE AUTOMATION, CONTROL & PROTECTION | | Supersedes: |
| Original Scale: NTS | | Drg. No. 2471W11004 |
| DRAWN MG/MM | CHECKED MM | APPROVED RDW |
| DATE 2/5/02 | IE | OPS PCP |
| Purch.Spec. TQ | | EAC |
| CE | STD | A1 |

NOT SUBJECT TO UPDATE
ONCE COPIED / PRINTED
OR DOWNLOADED

| 2 ROW | 13/08/03 | MNS13/240 MM |
|-------|----------|--------------|
| 1 | 02/05/02 | CHANGE |
| ISSUE | DATE | NOTED |

Copyright © 2002 VATECH REYROLLE ACP Ltd. Hebburn