

RELAY VIEWED FROM REAR

NOTES



1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.

SUPPLIER	AMP	CABLE SIZE
AMP	342103	0.25-1.6 SQ MM
AMP	342143	1.0-2.6 SQ MM.

OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).

3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

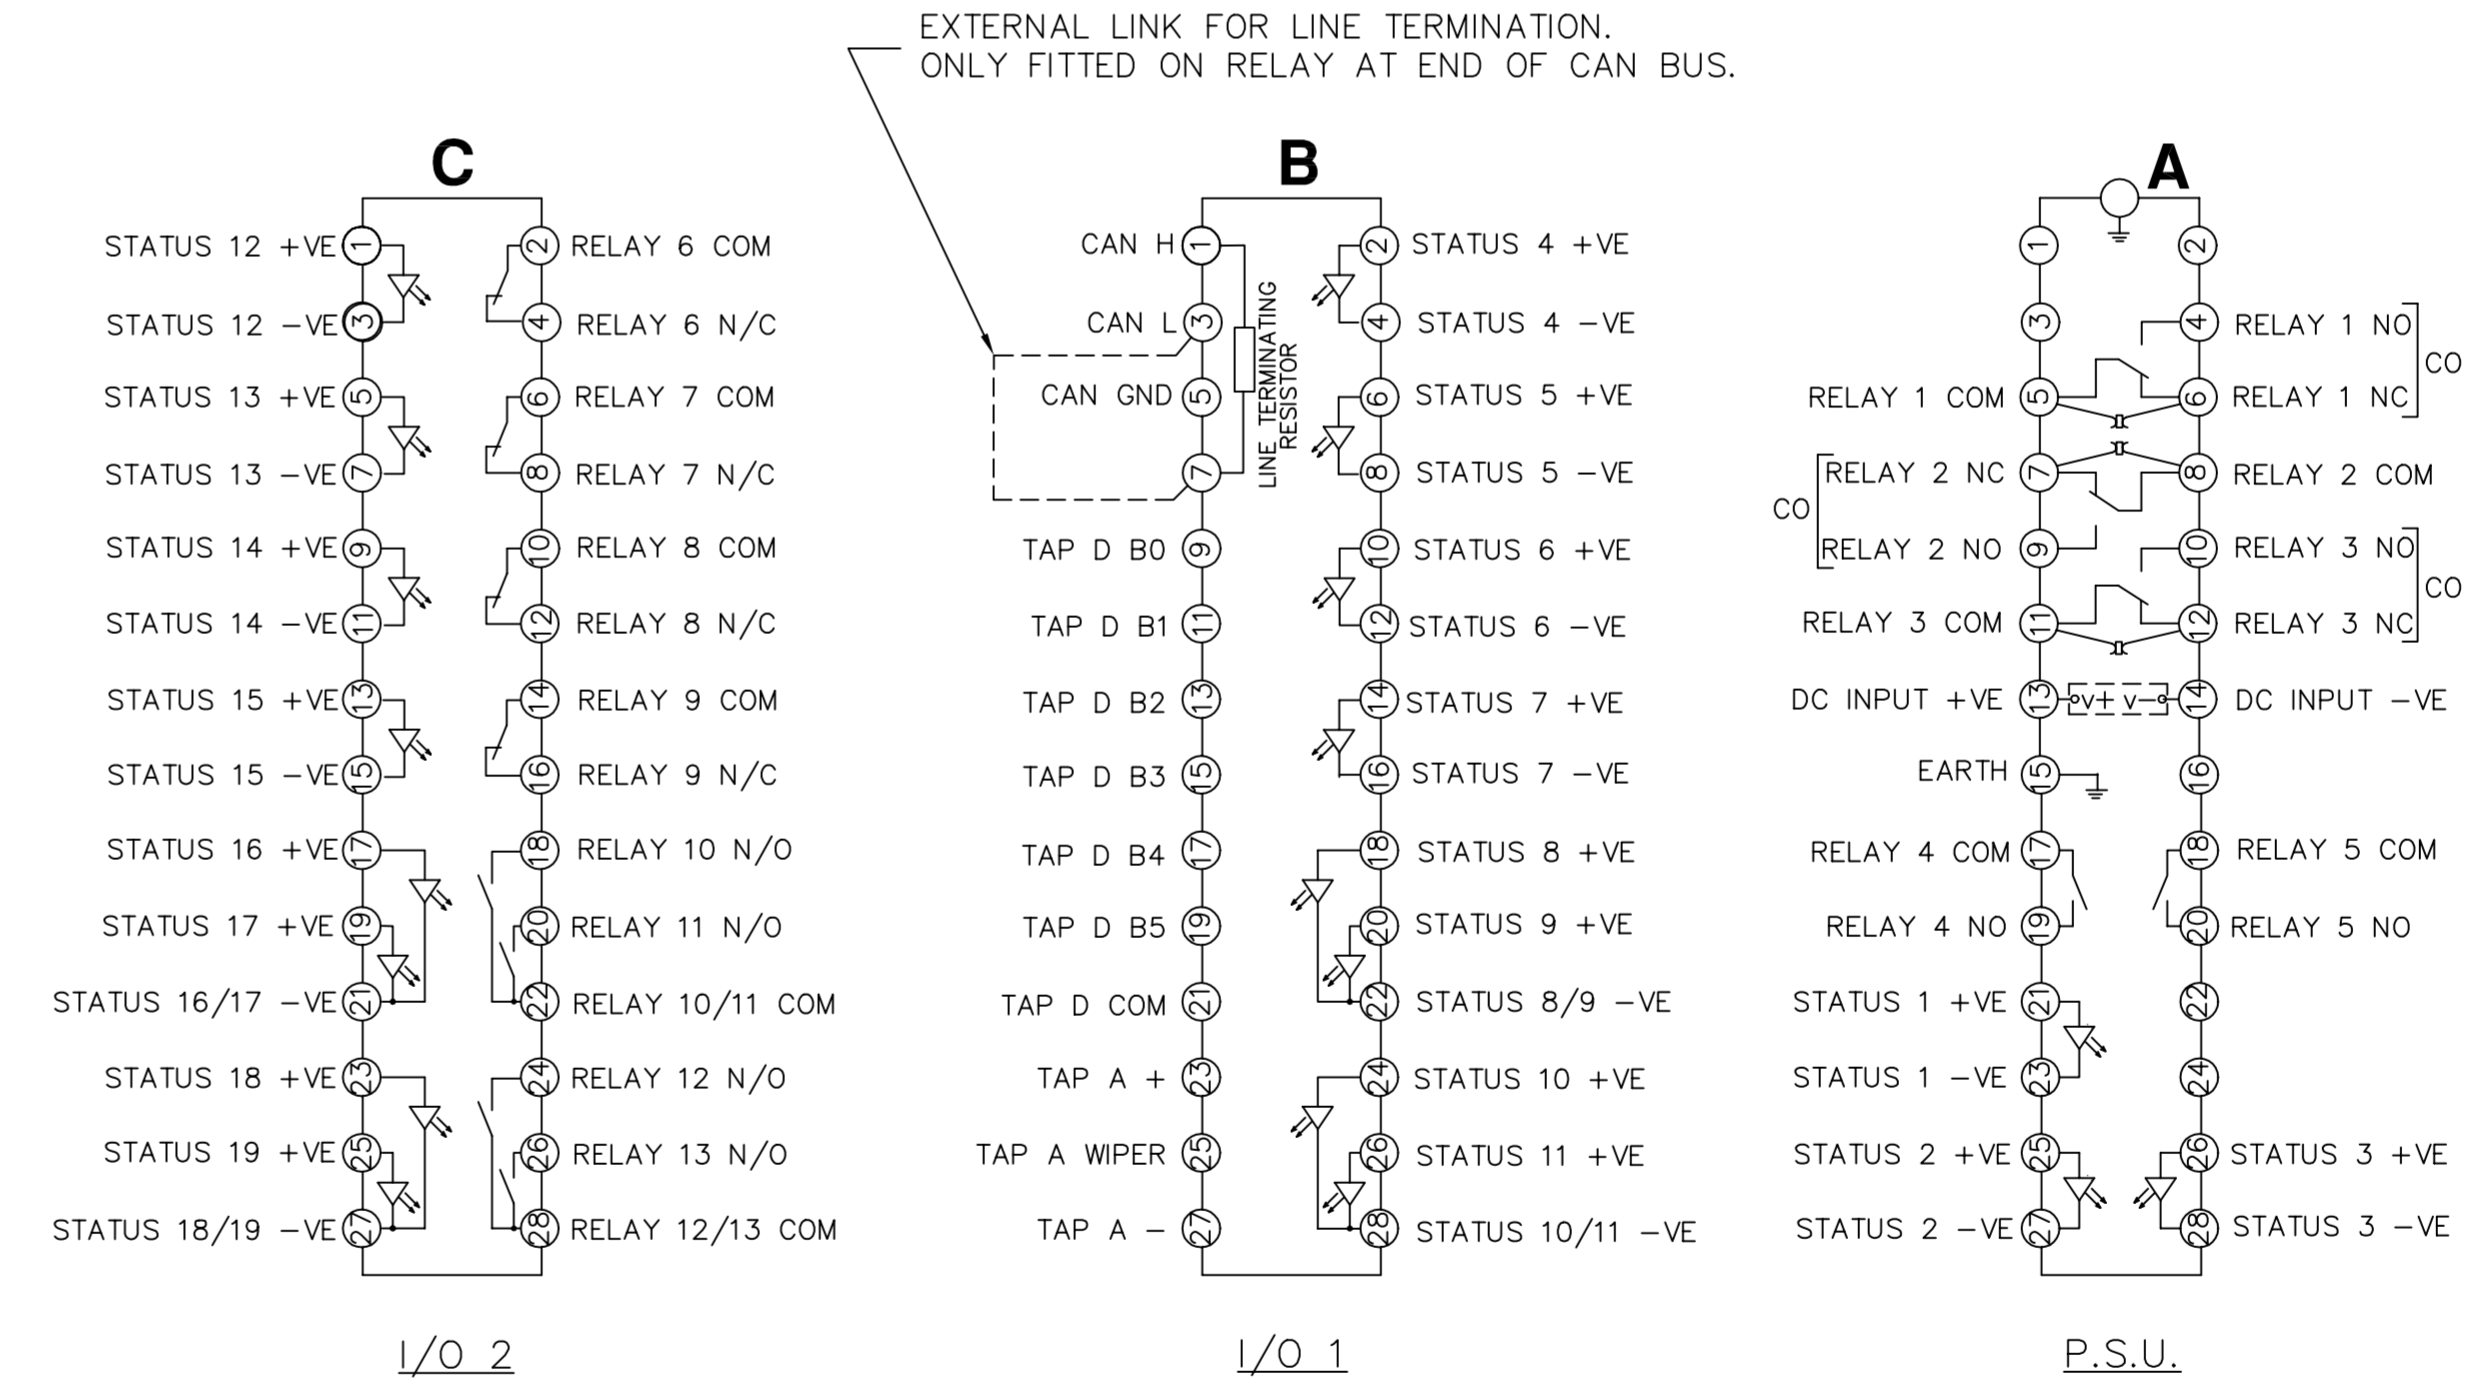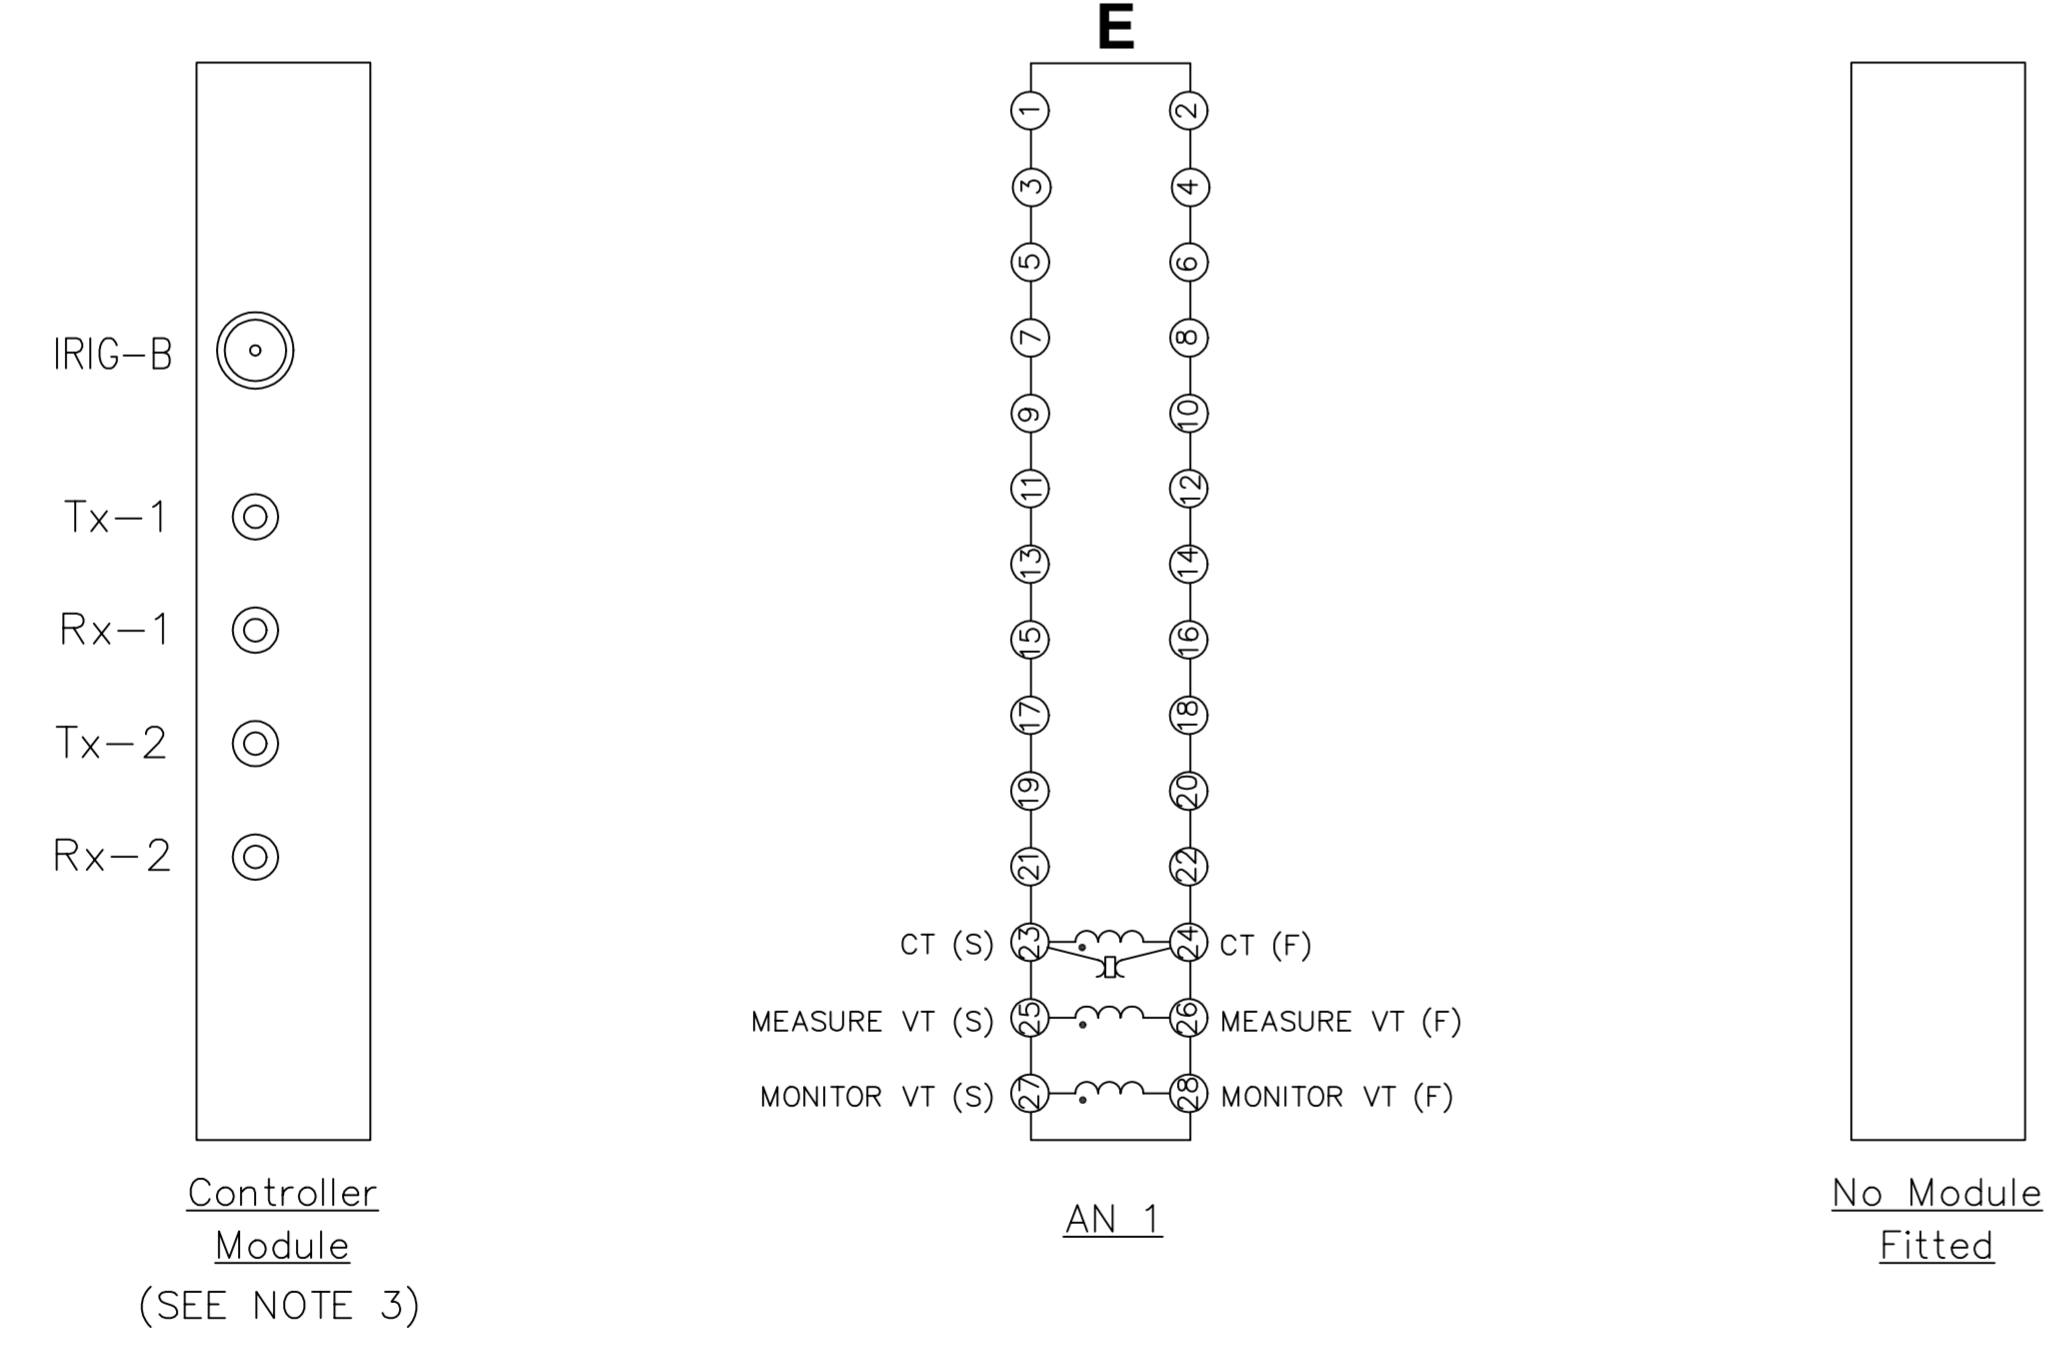

EXTERNAL LINK FOR LINE TERMINATION. ONLY FITTED ON RELAY AT END OF CAN BUS.

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

**MATERIAL:**  
 Dimensions in millimetres : Surface texture in micrometres.  
 Machine where marked ✓  
 For explanation of dimensions, tolerances, notes etc. see B.S.308.  
 Limit on untoleranced unmachined dimensions ±  
 Limits on untoleranced machined dimensions to B.S.4500;  
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;  
 over 6 to 30±0.2; over 120 to 315±0.5;  
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL IDENTIFICATION & RELAY WIRING DIAGRAM FOR MICROTAPP (1CT,2VT,19SI,3CO,6NO,4NC) E12 CASE	Similar Articles:
<b>VA TECH Reyrolle</b> <b>AUTOMATION, CONTROL &amp; PROTECTION</b>		Supersedes:
DATE 21/3/01	Original Scale: NTS	Original Drg. No. 2792W11002
IE DN OPS PCP	Purch.Spec. IQ	EAC CE STD A1

NOT SUBJECT TO UPDATE  
 ONCE COPIED / PRINTED  
 OR DOWNLOADED

3 ROW	29/08/03	MNS13/2440	MM
2	05/03/01	MIDDLE LABEL & POSTIN ADDED	
1	15/11/00	CHANGE	
ISSUE	DATE	NOTED	△