
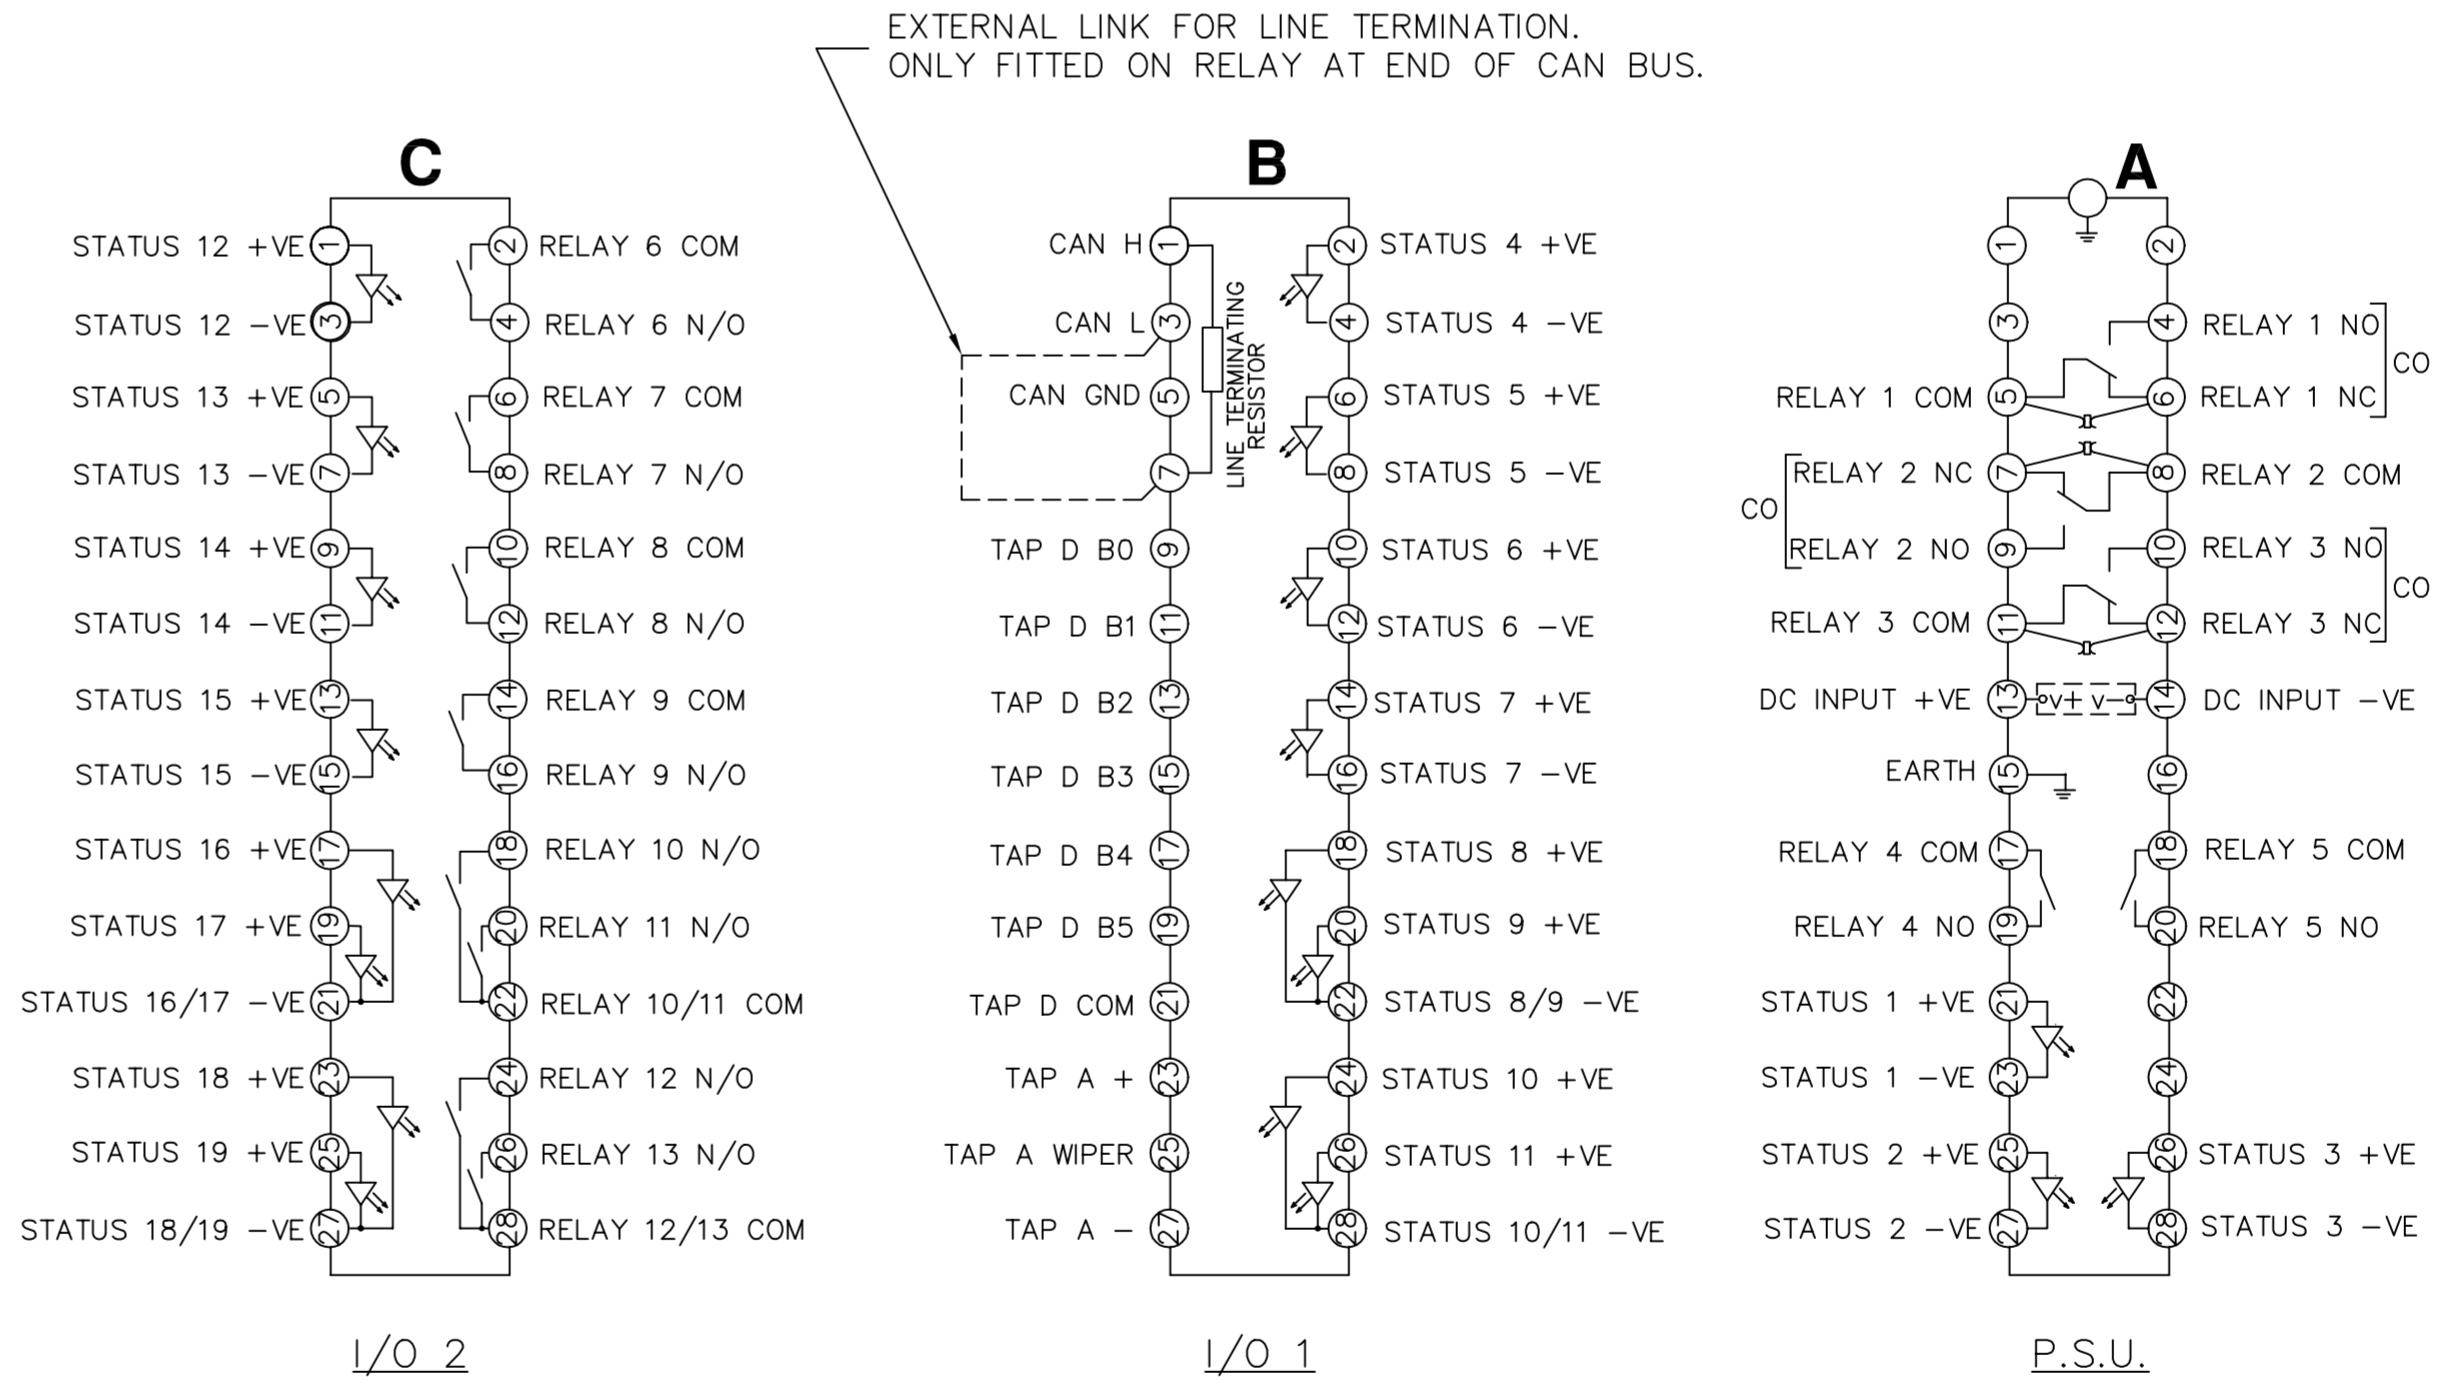


RELAY VIEWED FROM REAR

NOTES
 1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.
 SUPPLIER AMP CABLE SIZE
 AMP 342103 0.25-1.6 SQ MM
 AMP 342143 1.0-2.6 SQ MM.
 OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.
 2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).
 3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

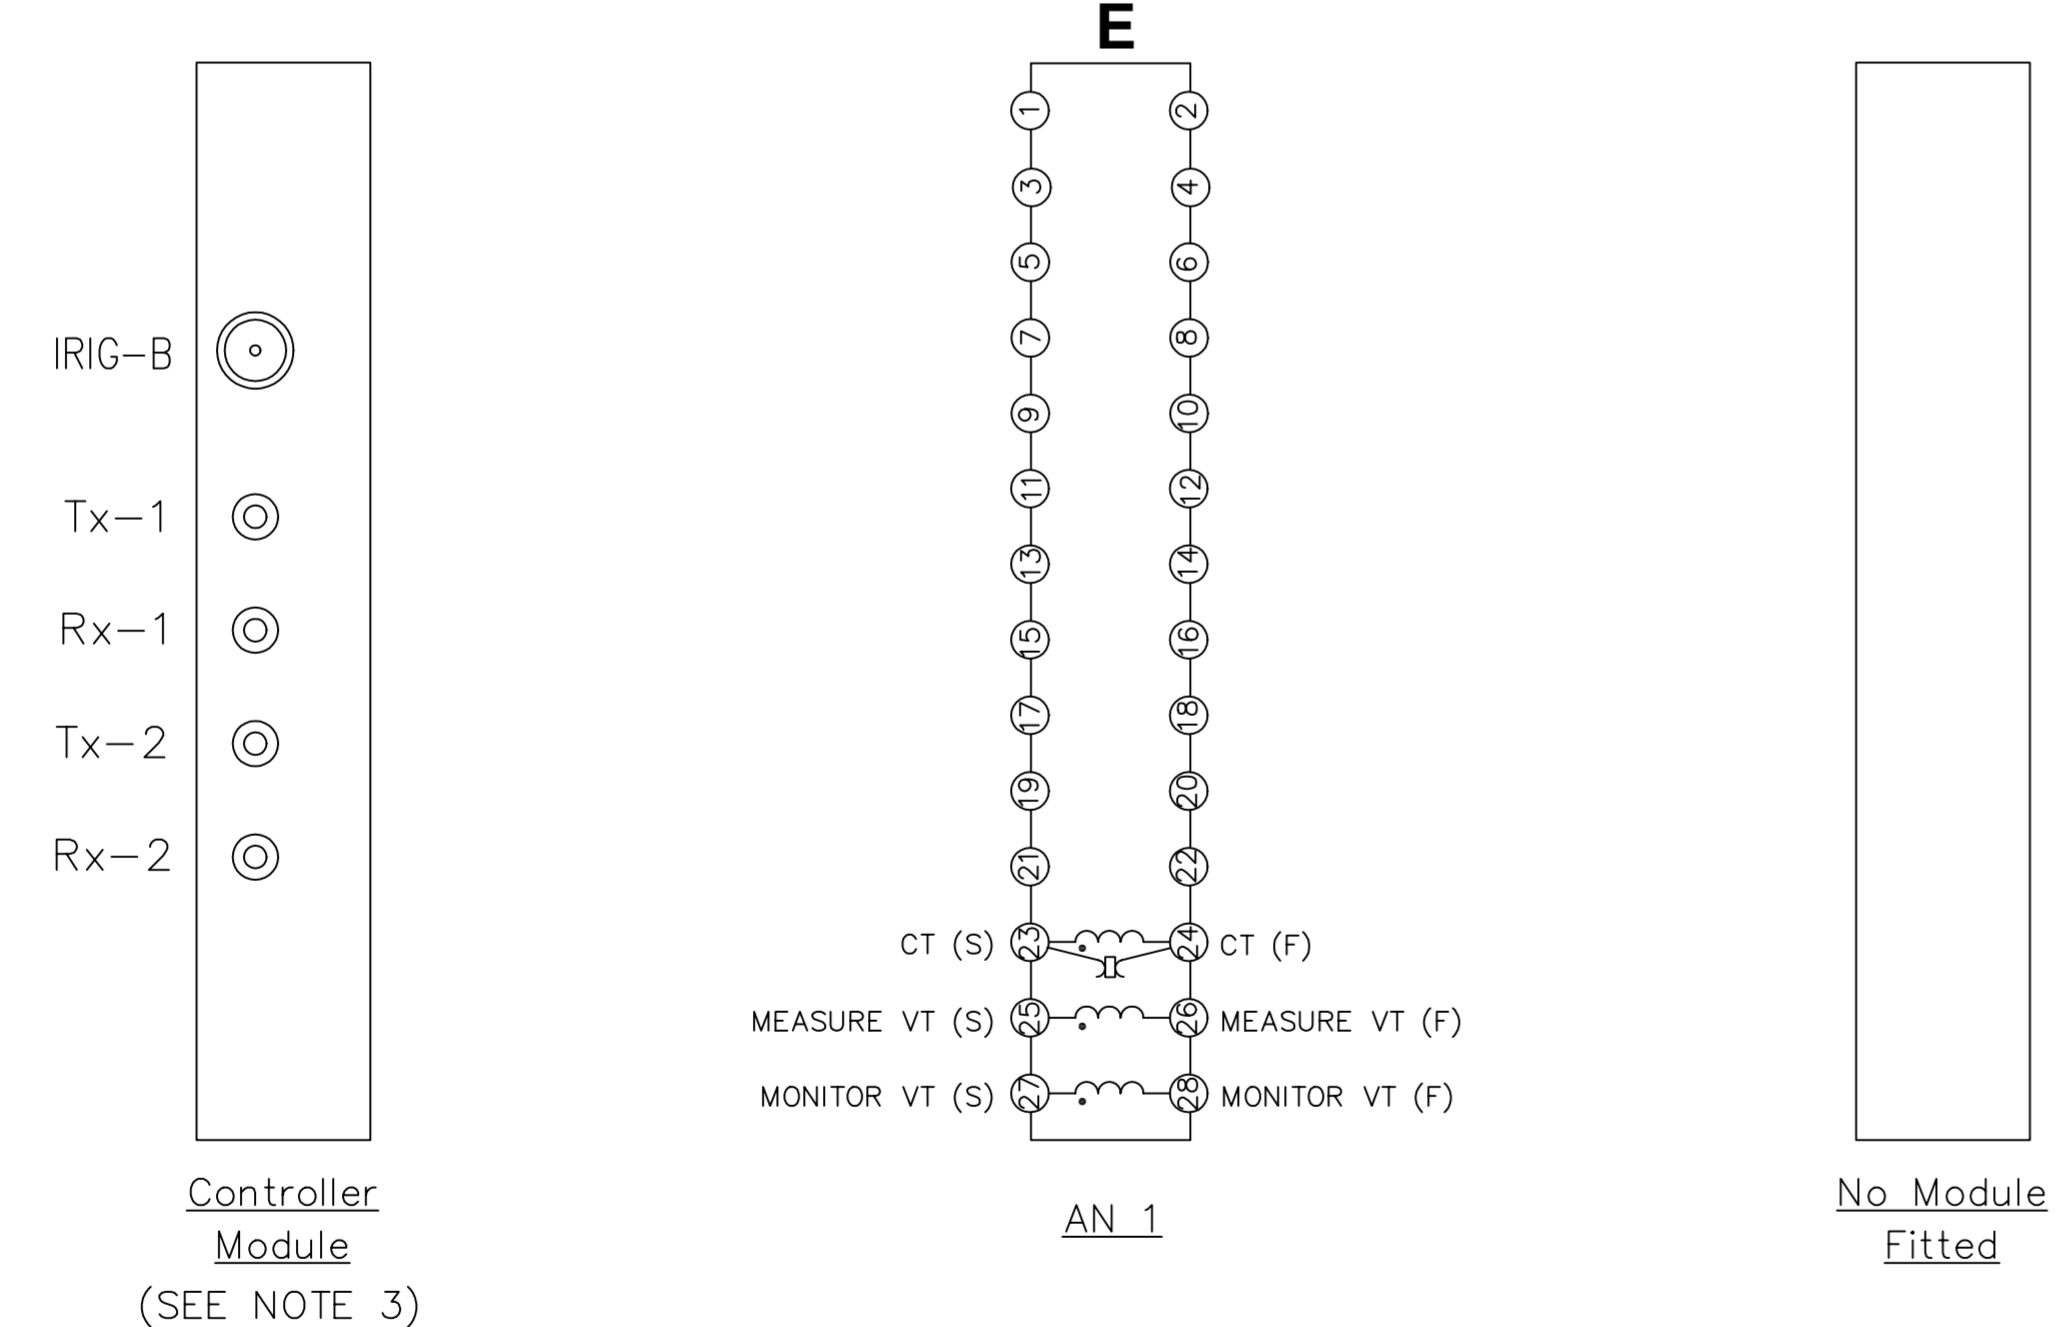

EXTERNAL LINK FOR LINE TERMINATION. ONLY FITTED ON RELAY AT END OF CAN BUS.

MODULE LABEL KEY

ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS

CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

MATERIAL:
 Dimensions in millimetres : Surface texture in micrometres.
 Machine where marked ✓
 For explanation of dimensions, tolerances, notes etc. see B.S.308.
 Limit on untoleranced unmachined dimensions ±
 Limits on untoleranced machined dimensions to B.S.4500;
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
 over 6 to 30±0.2; over 120 to 315±0.5;
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL IDENTIFICATION & RELAY WIRING DIAGRAM MICROTAPP (1CT,2VT,19SI,3CO,10NO) E12 CASE	Similar Articles: 2792W11003
	VA TECH Reyrolle AUTOMATION, CONTROL & PROTECTION	Supersedes:
	Original Scale: NTS	Drg. No. 2792W11003

Copyright © 2001 VA TECH Reyrolle Ltd. Hebburn

2 ROW	29/08/03	MNS13/240 MM
1	10/9/01	CHANGE
	ISSUE	DATE
		NOTED

Copyright © 2001 VA TECH Reyrolle Ltd. Hebburn

Drawn: M LEASK | Checked: ALAW | Approved: R.D. WATSON | Date: 15/9/01 | IE DN | OPS | PCP | Purch.Spec. | TQ | EAC | CE | STD | A1

NOT SUBJECT TO UPDATE ONCE COPIED / PRINTED OR DOWNLOADED