

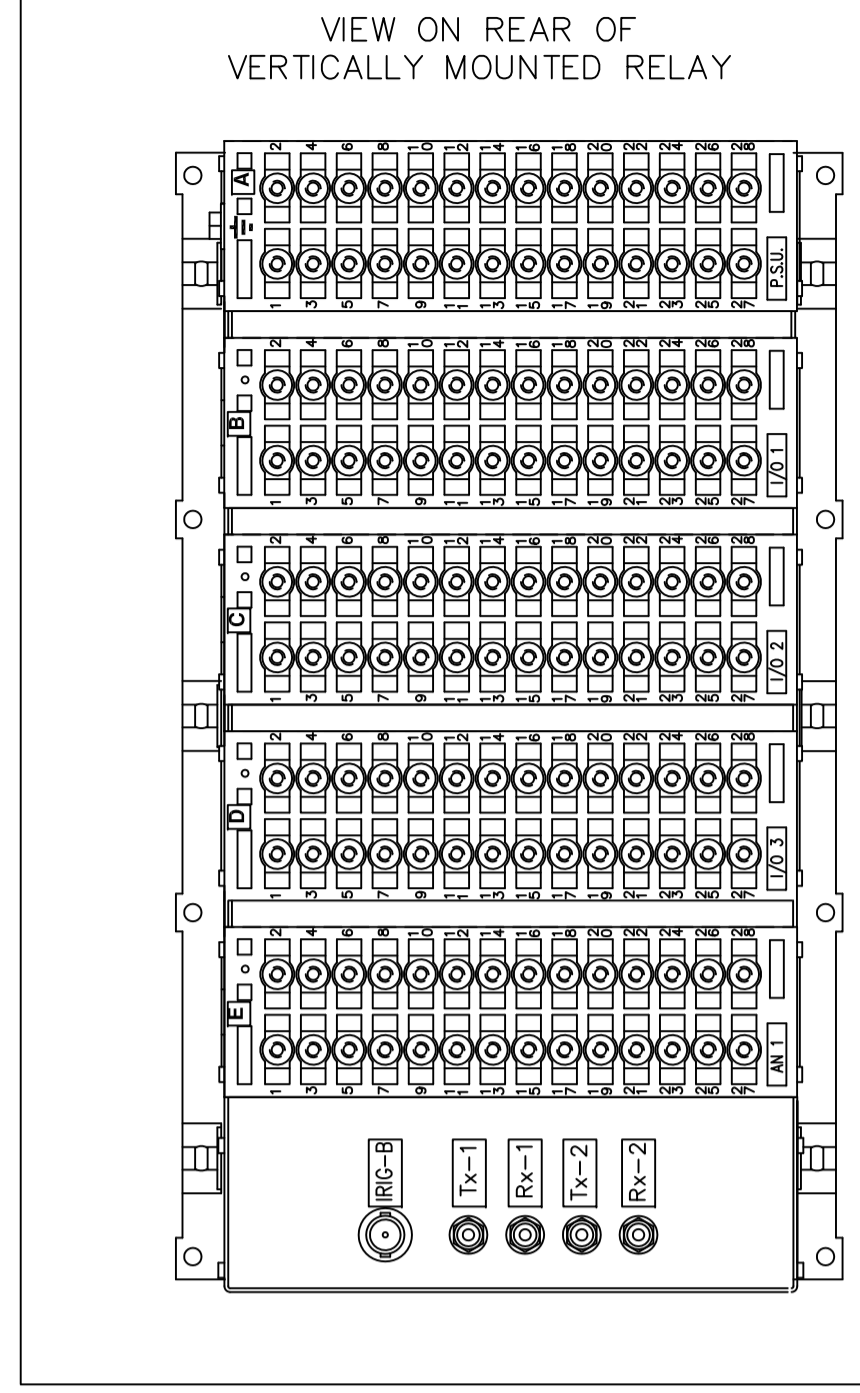


RELAY VIEWED FROM REAR

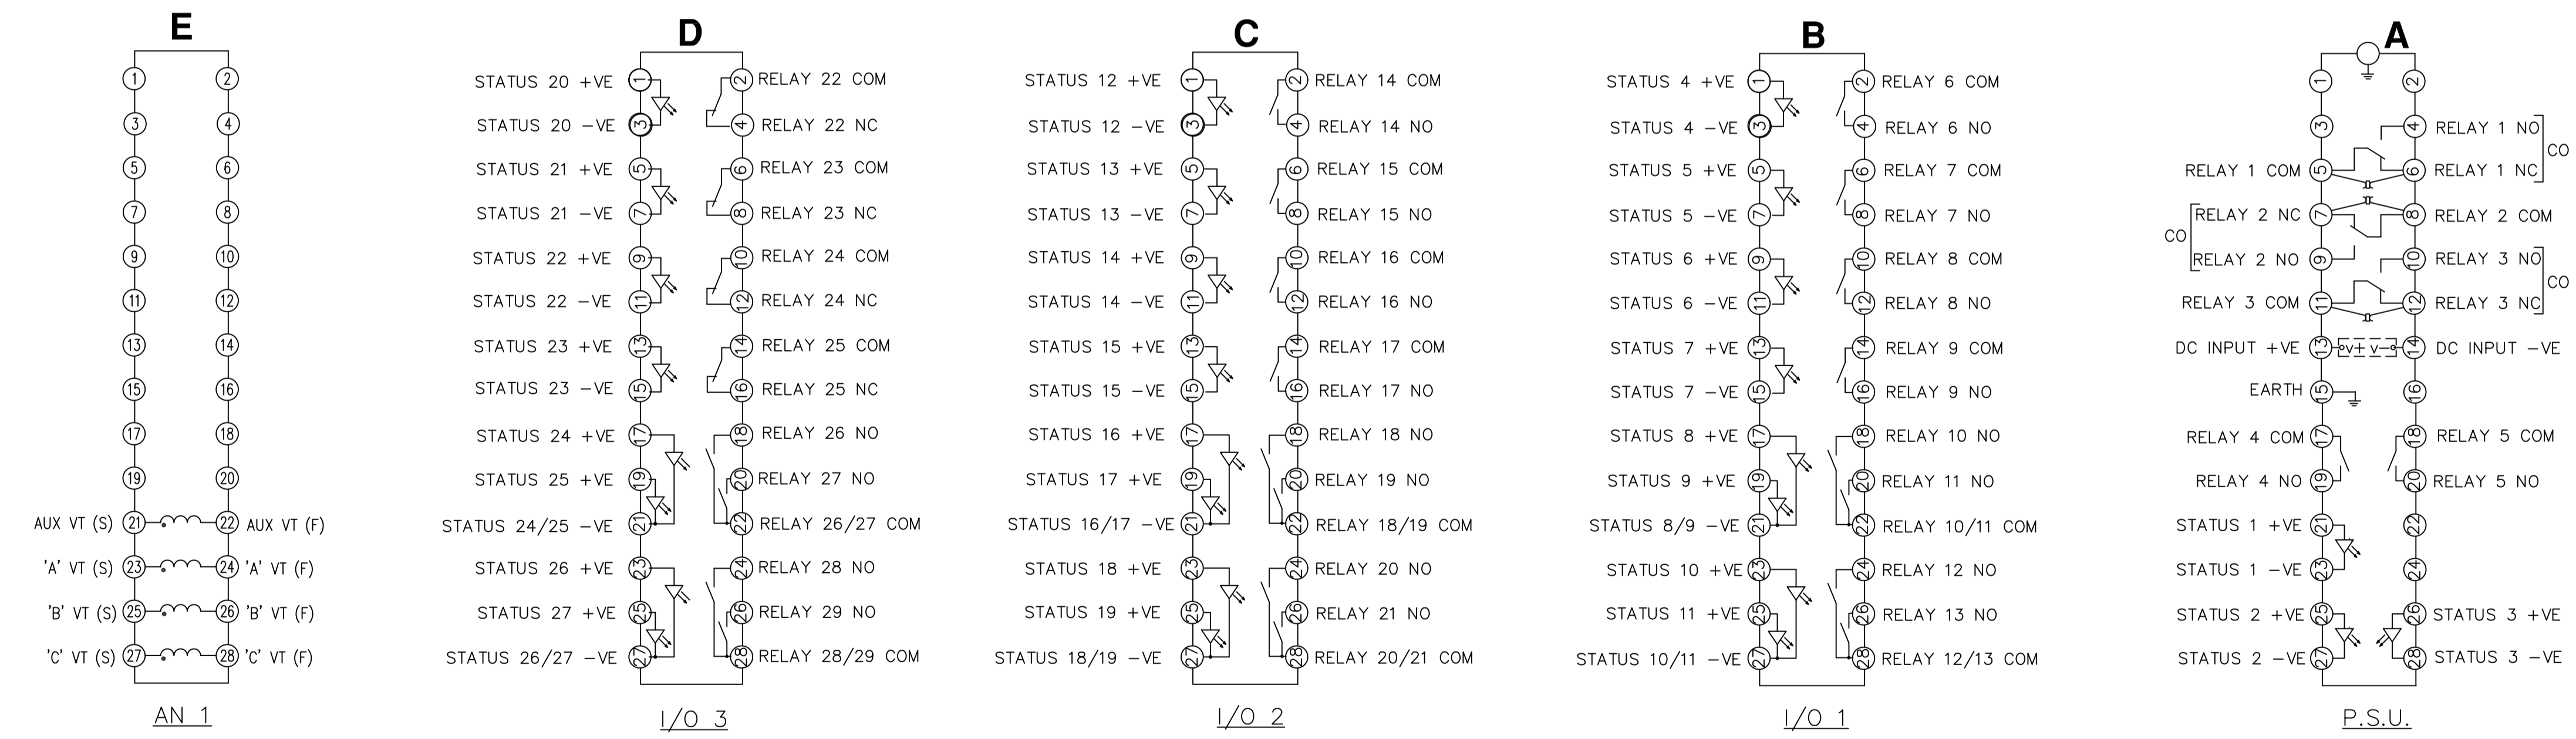

NOTES  
 1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.  
 SUPPLIER AMP 342103 CABLE SIZE 0.25-1.6 SQ MM  
 AMP 342143 1.0-2.6 SQ MM.  
 OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.  
 2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).  
 3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

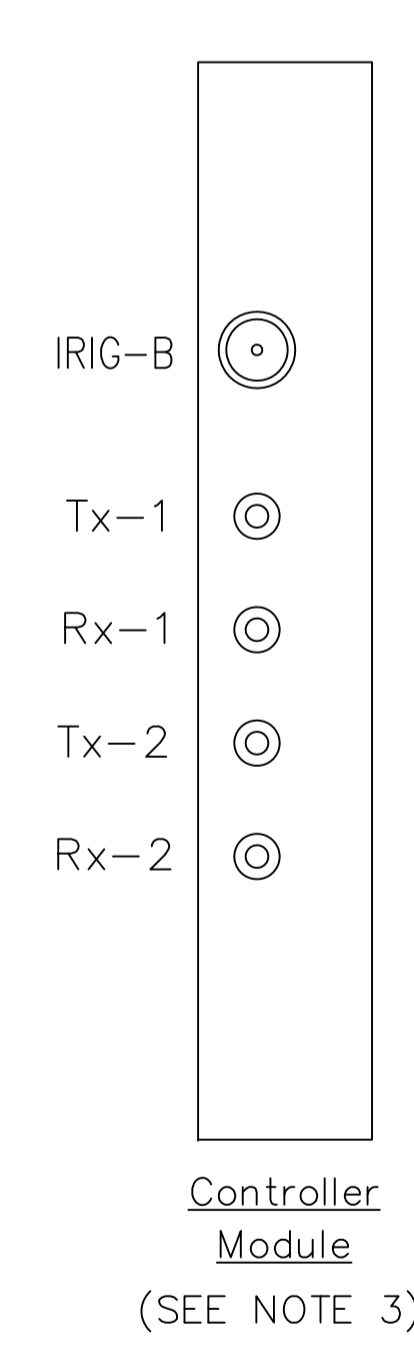

MODULE LABEL KEY

ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS

CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

**NOT SUBJECT TO UPDATE  
 ONCE COPIED / PRINTED  
 OR DOWNLOADED**

MATERIAL:  
 Dimensions in millimetres ; Surface texture in micrometres.  
 Machine where marked ✓  
 For explanation of dimensions, tolerances, notes etc. see B.S.308.  
 Limit on untoleranced unmachined dimensions ±  
 Limits on untoleranced machined dimensions to B.S.4500;  
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;  
 over 6 to 30±0.2; over 120 to 315±0.5;  
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL I.D. & WIRING FOR IOTA COMMON SERVICES RELAY (4VT,27SI,3CO,22NO,4NC) E12 CASE.	Similar Articles:
	<b>VATECH REYROLLE    AUTOMATION, CONTROL &amp; PROTECTION</b>	Supersedes:
	Original Scale: NTS	Drg. No. 2761W11040

Copyright © 2008 VATECH REYROLLE ACP Ltd. Hebburn

1	20/03/08	CHANGE
ISSUE	DATE	NOTED

DRAWN MM/RDW | CHECKED RDW | APPROVED RD.WATSON DATE 20/03/08 IE OPS PCP Purch.Spec. TQ EAC CE STD A1