



IF IN DOUBT ASK  
DO NOT SCALE

A


B

C


D

E

F

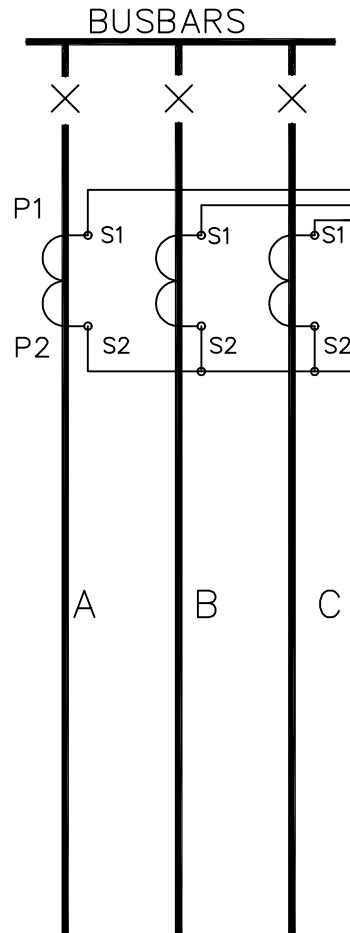

DCD31x C R6 Case Size


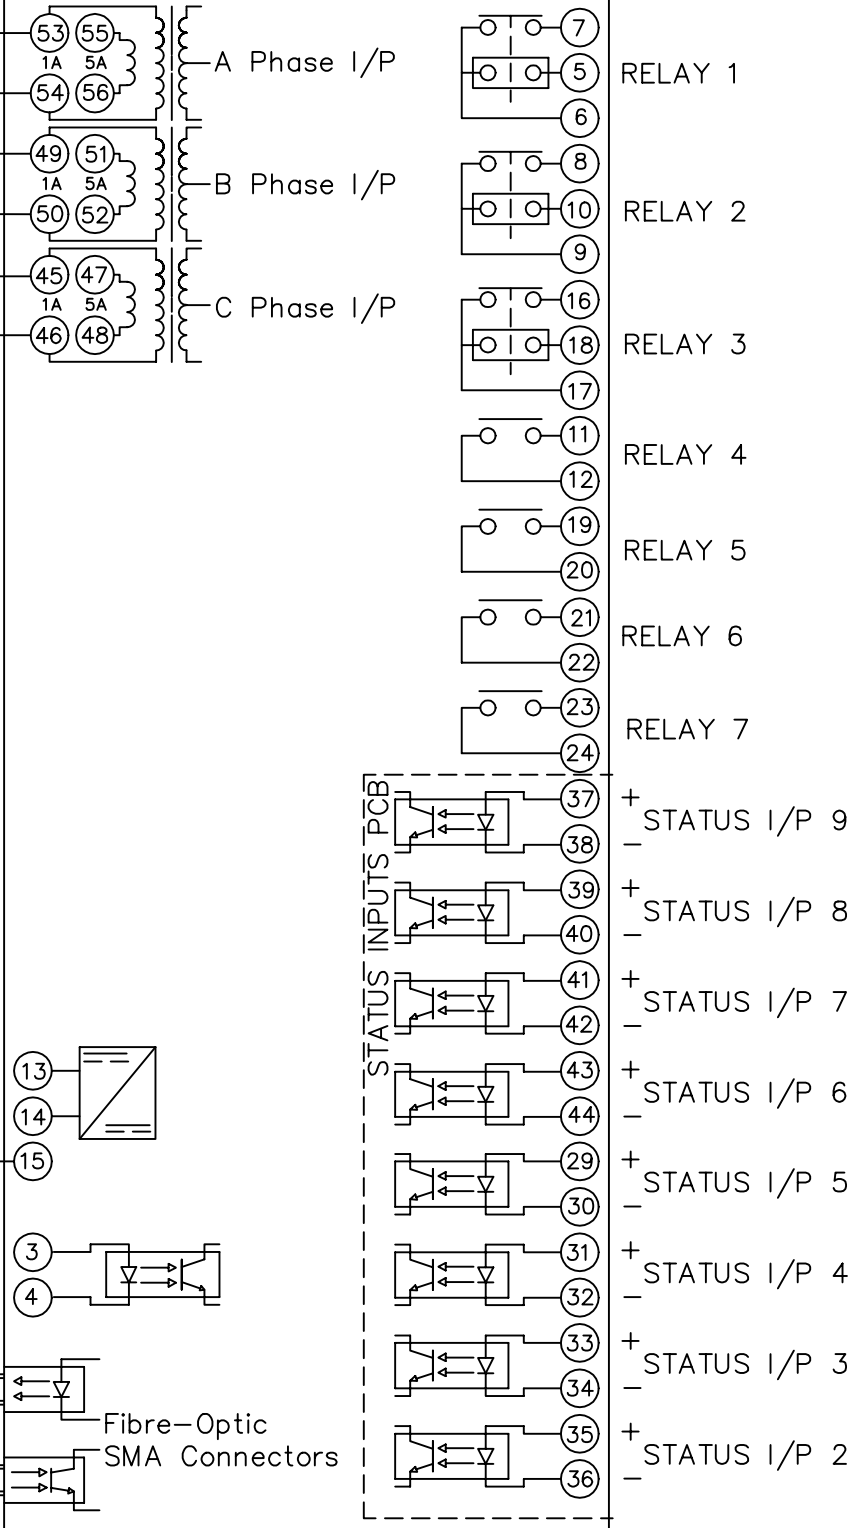


NOTES

- 1 CT CIRCUITS ARE SHOWN CONNECTED TO RELAY 1 AMP TAP. USE ALTERNATIVE TAP FOR 5AMP RATED CTs.
- 2 CT & EARTH CONNECTIONS ARE TYPICAL ONLY.
- 3 FOR TERMINAL DIAGRAM SEE 2434W20001 (A2)
- 4 DRG SHOWS OPTION C (7 O/P. 9 I/P).

NOT SUBJECT TO UPDATE  
ONCE COPIED / PRINTED  
OR DOWNLOADED

TERMINAL BLOCKS VIEWED FROM REAR

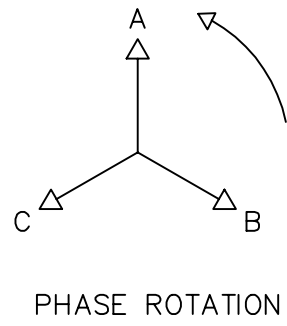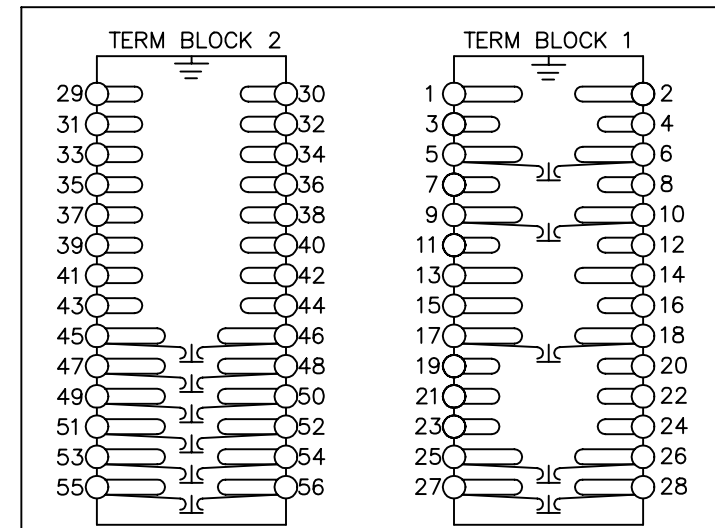

D.C Auxilliary Input Volts  
+ (13)  
- (14)

Earth (15)

STATUS I/P 1  
+ (3)  
- (4)

Fibre-Optic SMA Connectors  
TX (37)  
RX (38)

MATERIAL:

Dimensions in millimetres : Surface texture in micrometres.  
Machine where marked ✓  
For explanation of dimensions, tolerances, notes etc. see B.S.308.  
Limit on untoleranced unmachined dimensions ± \_\_\_\_\_  
Limits on untoleranced machined dimensions to B.S.4500;  
i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;  
over 6 to 30±0.2; over 120 to 315±0.5;  
General unmachined angular tolerance ± \_\_\_\_\_

Finish: \_\_\_\_\_  
Treatment: \_\_\_\_\_

Title: TYPICAL SCHEMATIC DIAGRAM FOR 3 PHASE  
DCD OVERCURRENT RELAY

**Reyrolle Protection  
Hebburn.**

Original Scale:  
NTS

First used on:  
Similar Articles: 2434W10017  
Supersedes:  
Drg. No. 2434W10031

DRAWN M LEASK	CHECKED	APPROVED R.D.WATSON	DATE 23/07/02	IE	OPS	PCP	Purch.Spec. TQ	EAC	CE	STD	A3
---------------	---------	---------------------	---------------	----	-----	-----	----------------	-----	----	-----	----

1	16/10/97	CHANGE NOTED
ISSUE	DATE	

Copyright © Reyrolle Ltd.