IF IN DOUBT ASK
DO NOT SCALE

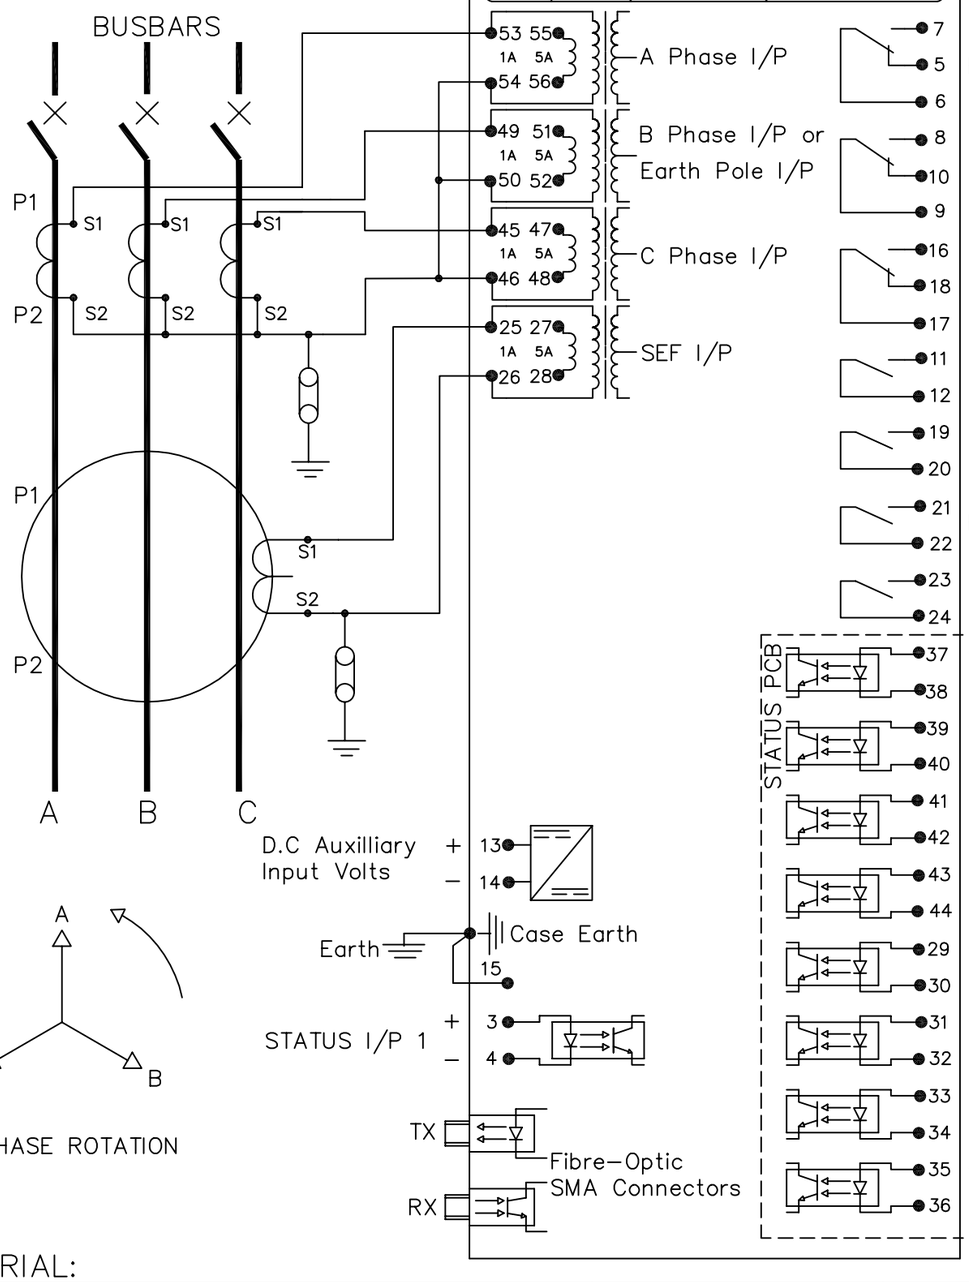

TERMINAL BLOCKS VIEWED FROM REAR

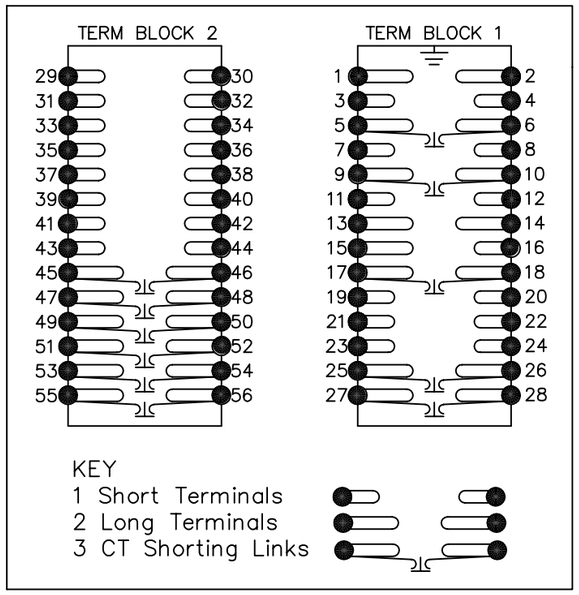

NOTES
1 CT CIRCUITS ARE SHOWN CONNECTED TO RELAY 1 AMP TAP.USE ALTERNATIVE TAP FOR 5AMP RATED CTs.
2 CT & EARTH CONNECTIONS ARE TYPICAL ONLY.
3 METROSIL & SETTING RESISTORS ARE REQUIRED FOR HIGH IMPEDANCE & RESTRICTED EARTH FAULT APPLICATIONS.
4 FOR TERMINAL DIAGRAM SEE 2716W20001 (A2)

NOT SUBJECT TO UPDATE ONCE COPIED / PRINTED OR DOWNLOADED

Copyright © Reyrolle Ltd.

ISSUE	DATE	CHANGE NOTED
1	16/9/98	△

MATERIAL:

Dimensions in millimetres : Surface texture in micrometres.
Machine where marked ✓
For explanation of dimensions, tolerances, notes etc. see B.S.308.
Limit on untoleranced unmachined dimensions ± _____
Limits on untoleranced machined dimensions to B.S.4500;
i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
over 6 to 30±0.2; over 120 to 315±0.5;
General unmachined angular tolerance ± _____

Finish:

Treatment:

Title: TYPICAL SCHEMATIC DIAGRAM FOR 3 PHASE & SEF OR 2 PHASE+EARTH+SEF.
NUMERIC OVERCURRENT PROTECTION ARGUS (3/4)

Reyrolle Protection Hebburn.

Original Scale. NTS

First used on:
Similar Articles:
Supersedes:

Drg. No. 2716W10002

DRAWN	CHECKED	APPROVED	DATE	IE	OPS	PCP	Purch.Spec.	TQ	EAC	CE	STD	A3
M LEASK		R.D.WATSON	24/07/02									

SIEMENS
siemens-russia.com