

NOTES

1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.


SUPPLIER	AMP	CABLE SIZE
AMP	342103	0.25-1.6 SQ MM
AMP	342143	1.0-2.6 SQ MM.

OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

2 FOR OUTLINE & DRILLING DRG SEE 2995X10016 (A4).

3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

RELAY VIEWED FROM REAR

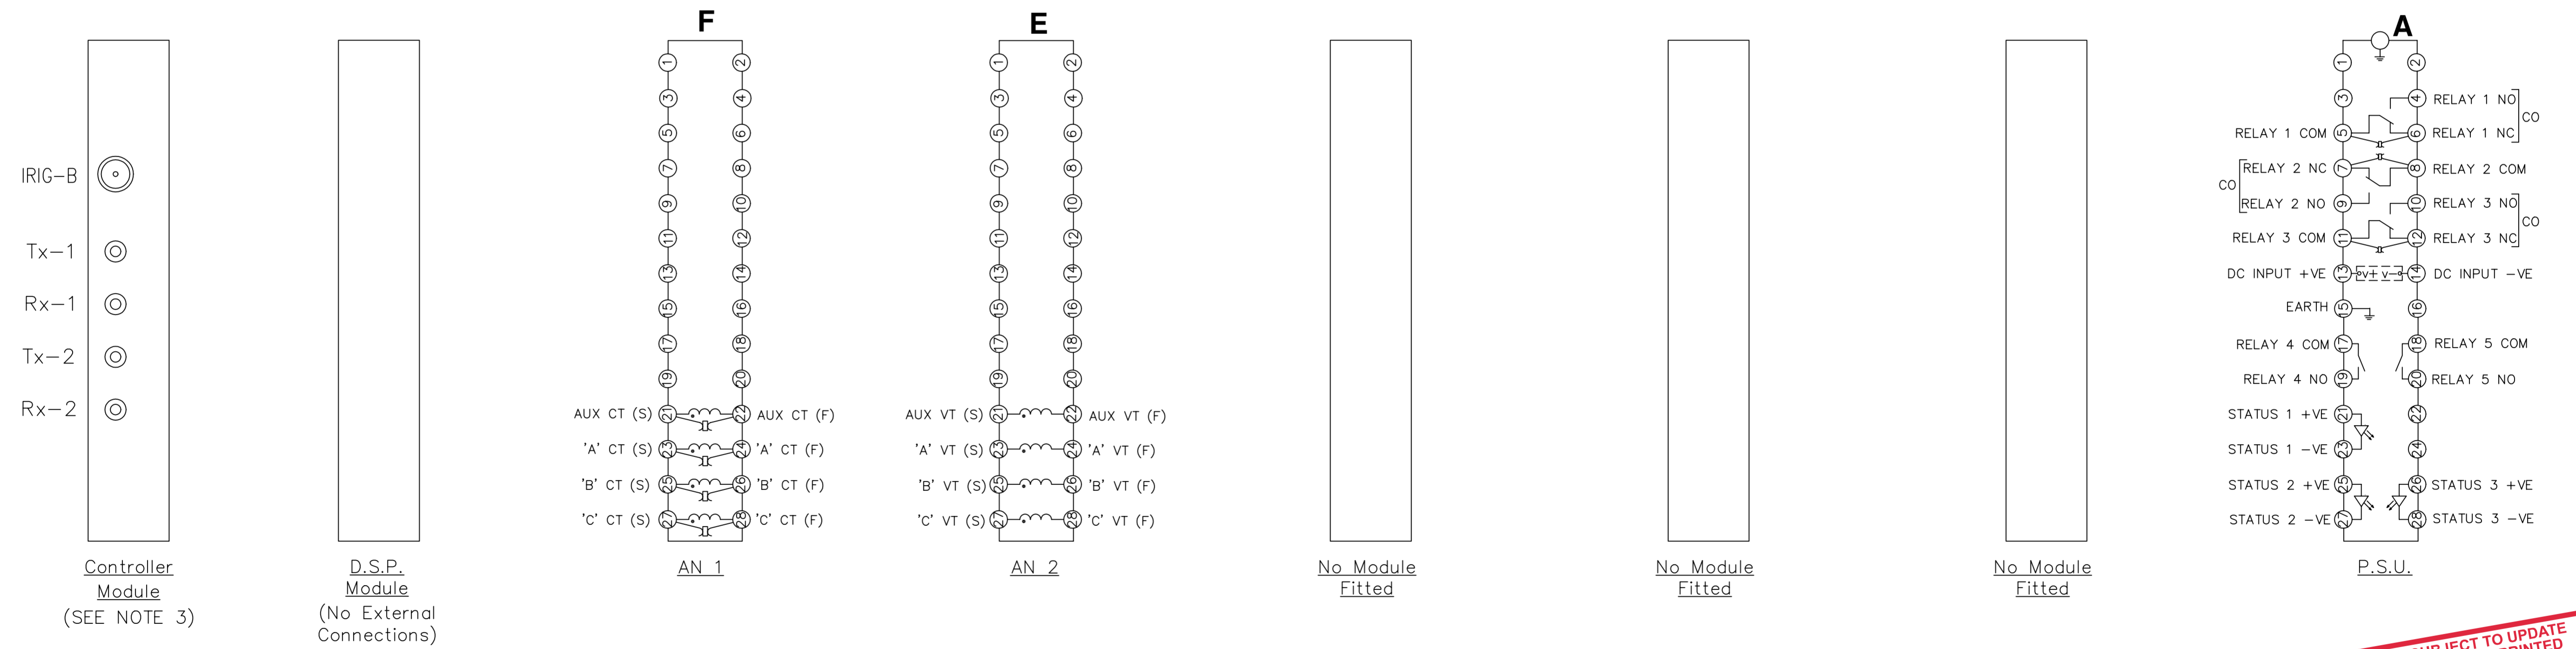

NOT SUBJECT TO UPDATE ONCE COPIED / PRINTED OR DOWNLOADED

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

MATERIAL:
 Dimensions in millimetres : Surface texture in micrometres.
 Machine where marked ✓
 For explanation of dimensions, tolerances, notes etc. see B.S.308.
 Limit on untoleranced unmachined dimensions ±
 Limits on untoleranced machined dimensions to B.S.4500;
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
 over 6 to 30±0.2; over 120 to 315±0.5;
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL ID & WIRING FOR OH1-XXX-XA (4CT,4VT,3SI,3CO,2NO) IN E16 CASE.	Similar Articles:
	VATECH REYROLLE	Supersedes:
	AUTOMATION, CONTROL & PROTECTION	Original Scale:
	NTS	Drg. No.
		2615W11006

Copyright © 1999 VATECH REYROLLE ACP Ltd. Hebburn

3 ROW	13/08/03	MNS13/2440 MW
2	27/02/08	MODULE LABEL & POSTN ADDED MNI1006/279
1	12/10/99	CHANGE
	ISSUE	DATE
		NOTED

Drawn: M. GREEN | Checked: A. Law | Approved: RDW | Date: 21/3/01 | IE | OPS | PCP | Purch.Spec. | TQ | EAC | CE | STD | A1